


Signature Series  
**AURA**  
 AMBIENT SYSTEM


TOP VIEW

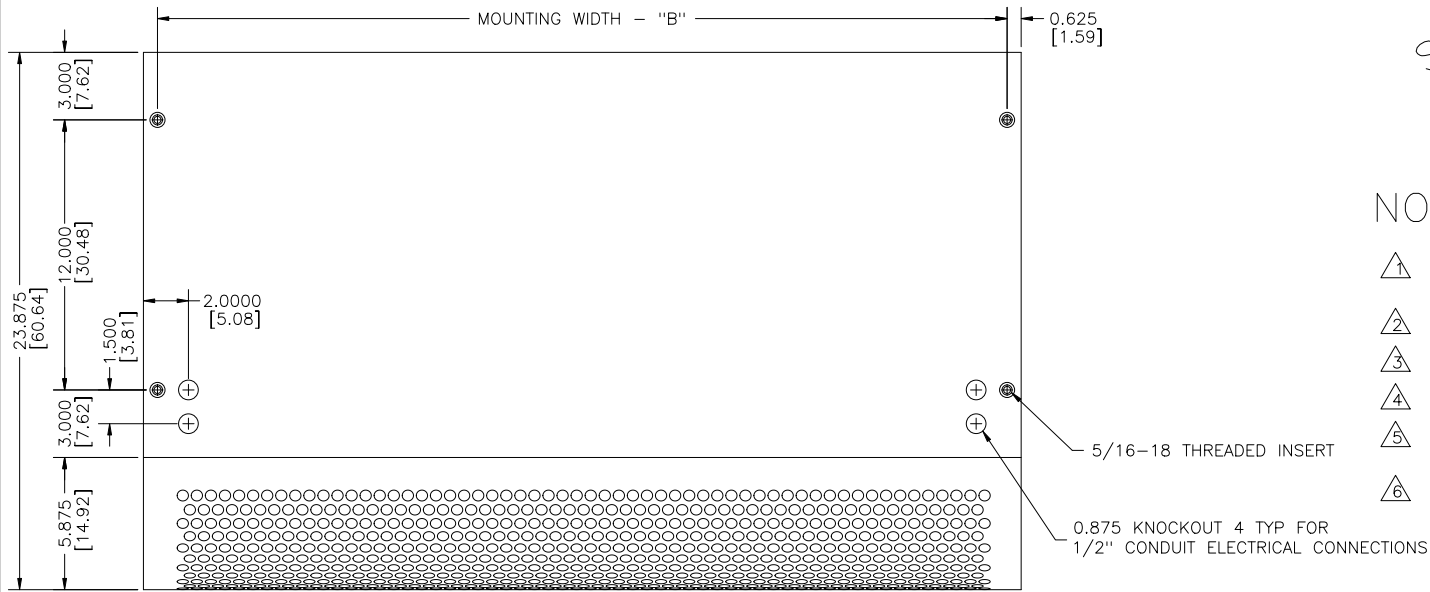


NOTES:

- ① AIR CURTAIN MUST BE INSTALLED SO AIR STREAM IS NOT OBSTRUCTED WHEN DEFLECTED 20° TO EITHER SIDE OF C. L.
- ② ELECTRICAL CONNECTIONS TO BE FLEXIBLE.
- ③ FIELD VERIFY DIMENSIONS.
- ④ ANCHORS TO SUPPORTING STRUCTURE BY OTHERS.
- ⑤ ADEQUACY OF SUPPORTING STRUCTURE IS TO BE VERIFIED BY A PROFESSIONAL STRUCTURAL ENGINEER.
- ⑥ DIMENSIONS INCHES [CENTIMETERS].


FRONT VIEW

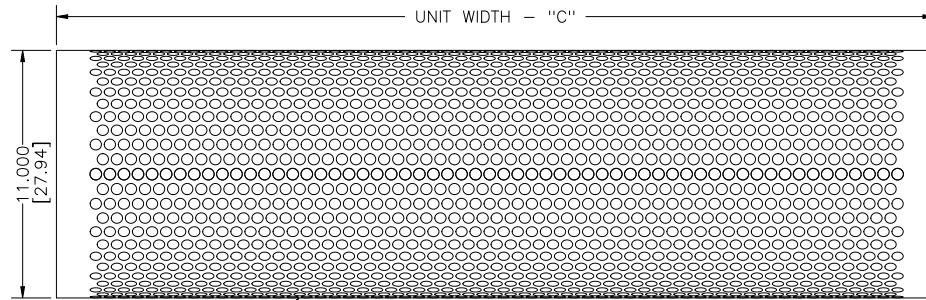

END VIEW

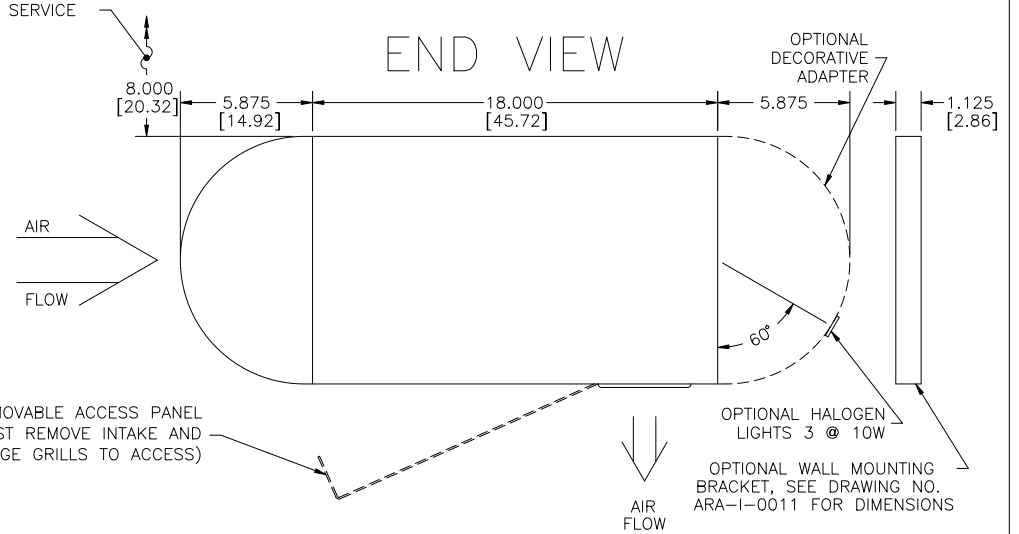

BOTTOM VIEW

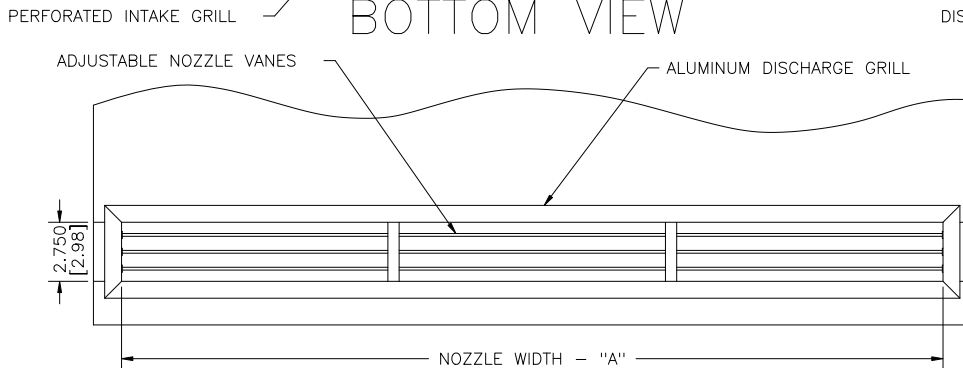

TAG	MODEL	NOZZLE WIDTH "A"	MOUNTING WIDTH "B"	UNIT WIDTH "C"
	ARA-1-36A	36.500 [92.71]	37.750 [95.89]	39.000 [99.06]
	ARA-1-42A	42.500 [107.95]	43.750 [111.13]	45.000 [114.30]
	ARA-1-48A	48.500 [123.19]	49.750 [126.37]	51.000 [129.54]
	ARA-1-60A	59.500 [151.13]	60.750 [154.31]	62.000 [157.48]

PROJECT		TITLE: <b>BERNER</b> MODEL AURA AIR CURTAIN AMBIENT SYSTEM
LOCATION		
ARCHITECT		BY: B. Peffer REPLACES: 20OCT98 BY: D. Johnson
ENGINEER		
DWG. NO.	ARA10010	BERNER INTERNATIONAL CORP. NEW CASTLE, PA.
DATE	21MAY01	