


EWD FRONT INTAKE AMBIENT SYSTEM

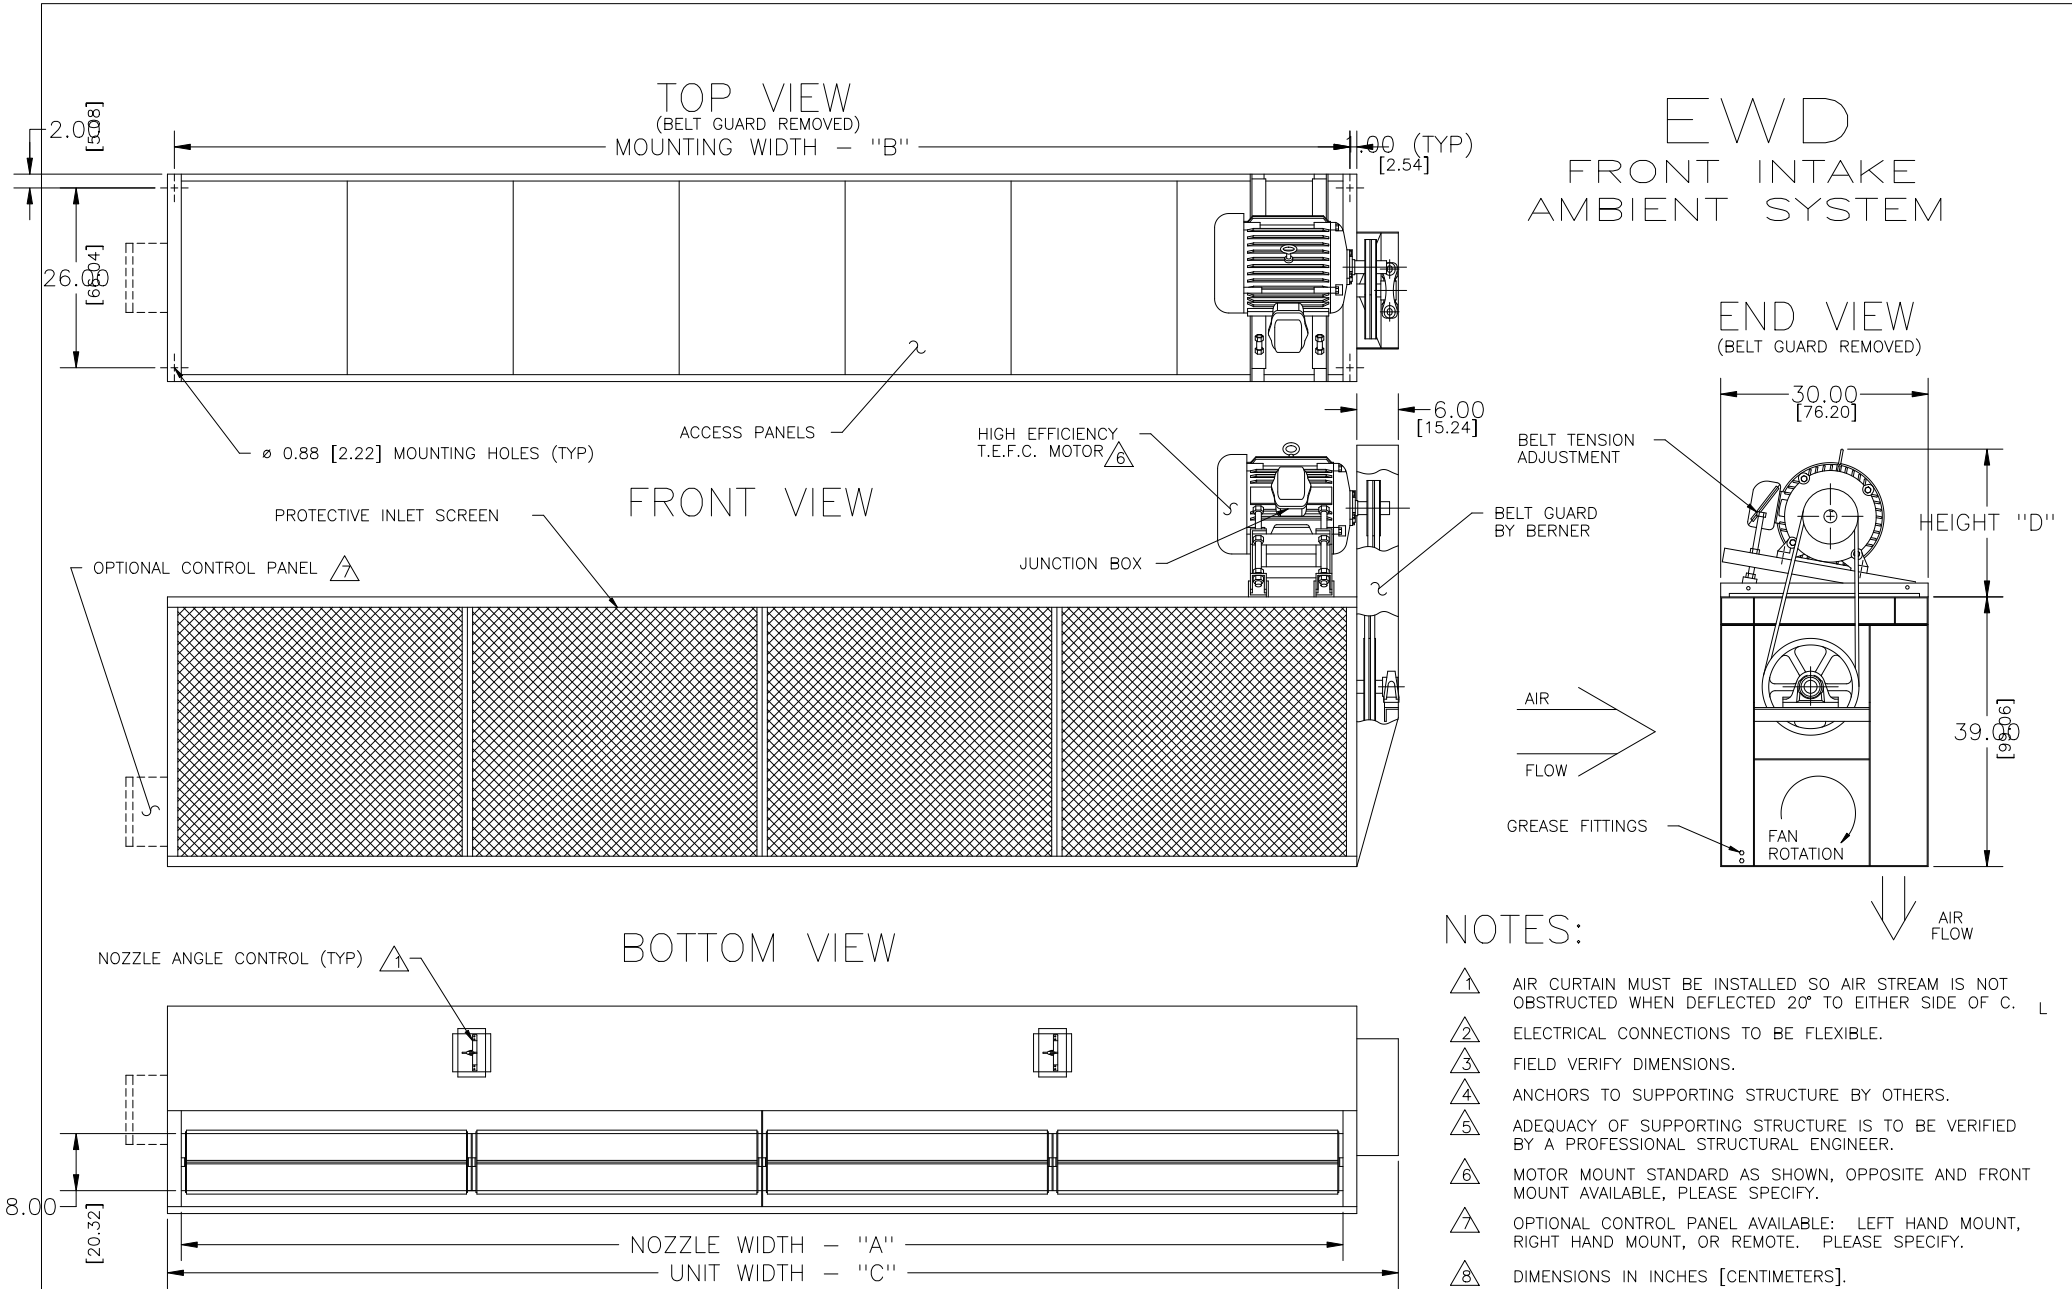

NOTES:

- 1 AIR CURTAIN MUST BE INSTALLED SO AIR STREAM IS NOT OBSTRUCTED WHEN DEFLECTED 20° TO EITHER SIDE OF C.
- 2 ELECTRICAL CONNECTIONS TO BE FLEXIBLE.
- 3 FIELD VERIFY DIMENSIONS.
- 4 ANCHORS TO SUPPORTING STRUCTURE BY OTHERS.
- 5 ADEQUACY OF SUPPORTING STRUCTURE IS TO BE VERIFIED BY A PROFESSIONAL STRUCTURAL ENGINEER.
- 6 MOTOR MOUNT STANDARD AS SHOWN, OPPOSITE AND FRONT MOUNT AVAILABLE, PLEASE SPECIFY.
- 7 OPTIONAL CONTROL PANEL AVAILABLE: LEFT HAND MOUNT, RIGHT HAND MOUNT, OR REMOTE. PLEASE SPECIFY.
- 8 DIMENSIONS IN INCHES [CENTIMETERS].

MODEL	NOZZLE WIDTH "A"	MOUNTING WIDTH "B"	UNIT WIDTH "C"	MAX MOTOR HEIGHT "D"
EWD-1-96A-F	96.00 [243.84]	98.00 [248.92]	106.00 [269.24]	20.50 [52.07]
EWD-1-108A-F	108.00 [274.32]	110.00 [279.40]	118.00 [299.72]	20.50 [52.07]
EWD-1-120A-F	116.00 [294.64]	118.00 [299.72]	126.00 [320.04]	20.50 [52.07]
EWD-1-144A-F	144.00 [365.76]	146.00 [370.84]	154.00 [391.16]	22.00 [55.88]
EWD-1-168A-F	168.00 [426.72]	170.00 [431.80]	178.00 [452.12]	22.00 [55.88]
EWD-1-192A-F	192.00 [487.68]	194.00 [492.76]	202.00 [513.08]	25.00 [63.50]

PROJECT		
LOCATION		
ARCHITECT		
ENGINEER		
DWG. NO.	EWDE2520	TITLE: BERNER
DATE	08NOV01	MODEL EWD AIR CURTAIN
BY	B. Peffer	FRONT INTAKE AMBIENT SYSTEM
REPLACES	09FEB98	
BY	B. Peffer	BERNER INTERNATIONAL CORP. NEW CASTLE, PA.