




SECTIONAL VIEW - ORION-S151WS(T3)

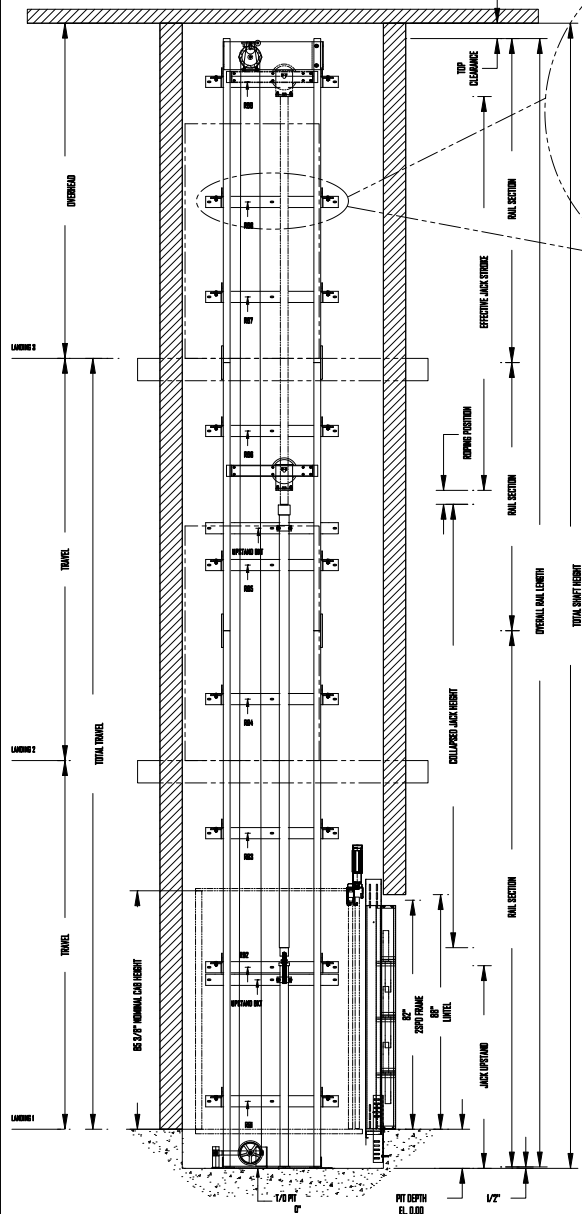


PIT / OVERHEAD REQUIREMENTS			
MAX. SPEED (ft/min)	PIT	TOTAL TRAVEL	OVERHEAD
			NEW BLDG
30	14" ***		EXISTING BLDG
			131" (3227)
			120" (3048)

*** NOTE: Additional pit equipment required when over 35" deep, consult your local dealer for details

PLAN VIEW - ORION-S151WS(T3) 2 SPEED WITTUR DOORS

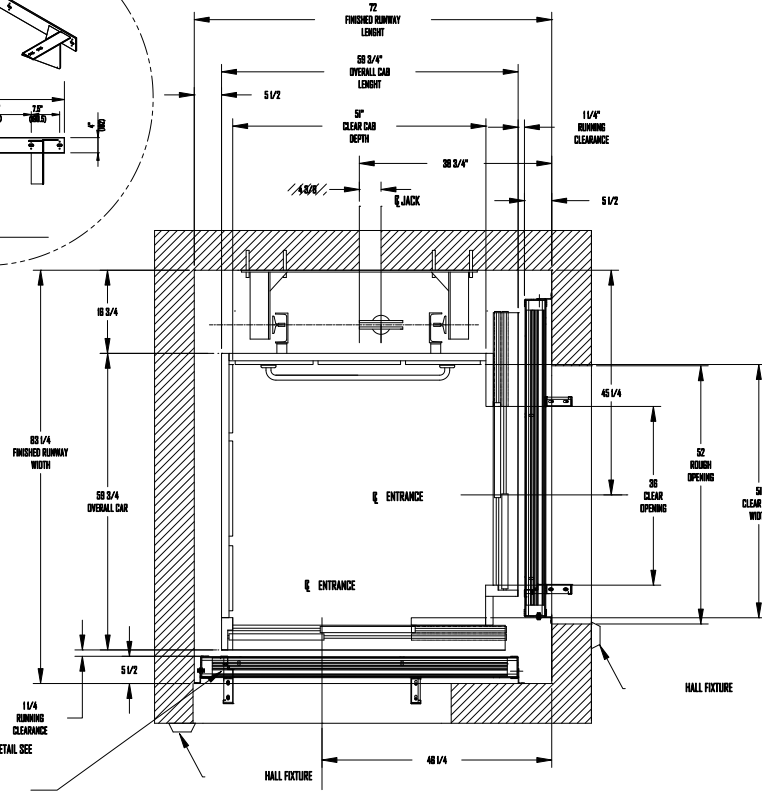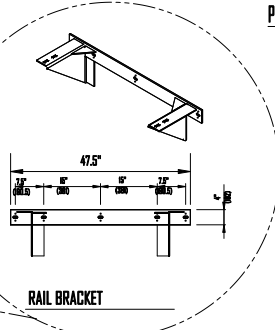

FOR ENTRANCE MOUNTING DETAIL SEE DRAWINGS# ENT-WITTUR-MA OR ENT-WITTUR-0W

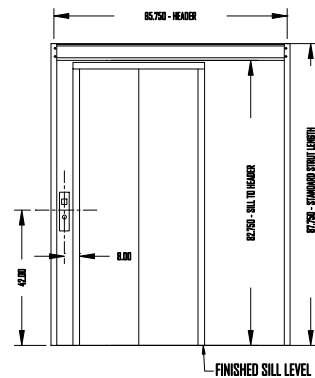

HALL FIXTURE LOCATION

RAIL FORCES		R3 NOTE:	
R1	R2	PIT FLOOR TO SUPPORT LOAD IE:	(INCLUDES MP/IC)
700 N/A/2.00	700 N/A/1.00	100 N/A/4.000	
RAIL WEIGHT: 2.0 lb / ft		FOR TOTAL PULL-OUT FORCE ON RAIL BRACKET, R3 MUST BE DIMENSIONED UP.	

NOTE A: WHERE SMOKE DETECTORS ARE REQUIRED, WIRES FROM A NORMALLY CLOSED CONTACT AT BOTH THE DESIGNATED RETURN LANDING, SMOKE DETECTORS AND ALTERNATE RETURN LANDING SMOKE DETECTOR SHALL BE PROVIDED TO THE CONTROLLER. A NORMALLY CLOSED CONTACT REPRESENTING ALL OTHER SMOKE DETECTORS MUST BE PROVIDED TO THE CONTROLLER.

NOTE B: ALL INFORMATION IS SUBJECT TO CHANGE. PLEASE REFERENCE OUR ON-LINE DRAWINGS AT www.concord-elevator.com FOR THE MOST RECENT UPDATES

PROVISIONS BY OTHERS

- *GENERAL** - THE HOISTWAY MUST BE IN ACCORDANCE WITH SAFETY CODE FOR ELEVATORS (ASME A17.3 OR B44-2000) AND ALL STATE/PROVINCIAL AND LOCAL CODES.
- HOISTWAY** - DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.
- PLUMB HOISTWAY** - DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.
- MINIMUM OVERHEAD CLEARANCE** - OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.
- CONSTRUCTION SITE** - OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT.
- DIMENSIONS** - CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.
- *STRUCTURAL** - STRUCTURAL ENGINEER TO ASSURE FLOOR/SUPPORT WALL LOADS - THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE TABLES ON THIS DRAWING FOR LOADS IMPOSED BY THE EQUIPMENT.
- DOORS** - SUITABLE LIMITS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.
- *MACHINE ROOM** - MACHINE ROOM LOCATED AT THE LOWEST LEVEL ADJACENT TO HOISTWAY, UNLESS SHOWN OTHERWISE ON THE LAYOUT DRAWINGS. FIELD ADJUSTMENT BY INSTALLER MAY BE NECESSARY TO MEET JOB SITE CONDITIONS OR REGULATIONS. ACCESS TO MACHINE ROOM TO BE THROUGH A SELF CLOSING AND SELF LOCKING DOOR.
- SLEEVES FOR OIL & ELECTRIC LINES** - PROVIDED BY OTHERS, FROM MACHINE ROOM TO HOISTWAY. (POSITION PER INSTALLERS INSTRUCTIONS).

MOTOR INFO	INPUT VOLTAGE (V/PH/CYCLE)	DISCONNECT SIZE (AMPS)	TIME DELAY FUSE (AMPS)	FULL LOAD CURRENT (AMPS)
	208/240V/60HZ	30	30	15.6
	230/240V/50HZ	30	50	21
CAB LIGHTS	115/PH		6	

- *ELECTRICAL** - (SEE SPECIFICATIONS) LOCKABLE FUSED DISCONNECT WITH AUXILIARY CONTACT TO BRAKE THE BATTERY FEED, OR CIRCUIT BREAKERS WITH A 3-POLE BREAKER FOR BATTERY FEED REQUIRED. IN COMPLIANCE WITH ELECTRICAL CODE, AS FOLLOWS: (LOCATED ON WALL ON LOCK JAMB SIDE OF MACHINE ROOM DOOR)
- PERMANENT POWER** - BEFORE INSTALLATION CAN BEGIN, PERMANENT POWER MUST BE SUPPLIED.
- LIGHTING** - OWNER/AGENT TO ENSURE AT LEAST 5 FFC OR 54 LUX AMBIENT LIGHTING OVER ELEVATOR AREA.
- *ENTRANCES** - FASCIA PANEL BELOW UPPER LEVEL ENTRANCES - WHERE REQUIRED. FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS. HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT AND THE FASCIA MUST BE PROVIDED BY OTHERS.
- ENTRANCE ASSEMBLIES** - ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT. OTHERS TO ALLOW AN ADEQUATE ROUND OPENING.
- RETURN WALLS** - RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS BY ELEVATOR CONTRACTOR.

REV-000



LU/LA
ORION MODEL 5151 (T3)