ASSA ABLOY
ASSA ABLOY Entrance Systems
1900 Airport Road
Monroe, NC 28110
Phone: 1-866-237-2687
specdesk.na.besam@assaabloy.com

BESAM FIRE DOOR ACCESSORY PACKAGE U.L. RATED

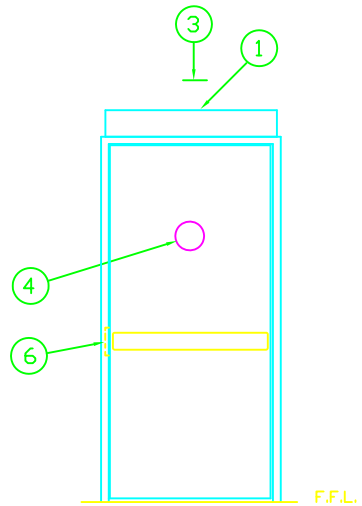

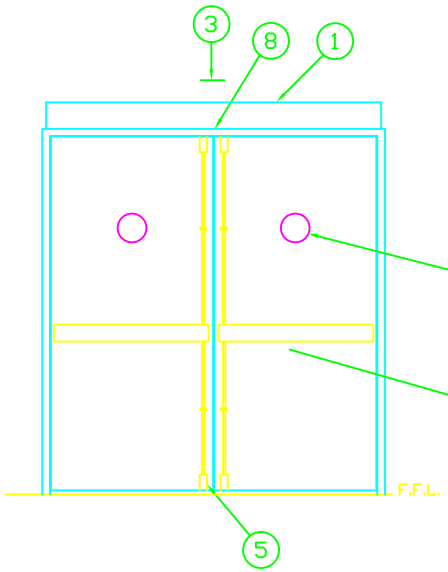

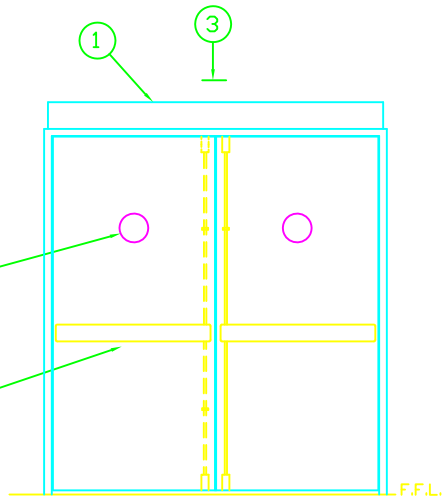

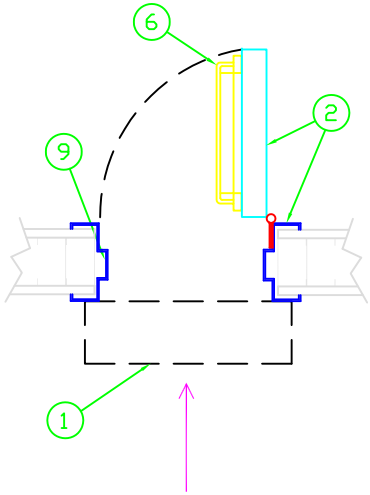

SINGLE FIRE DOOR

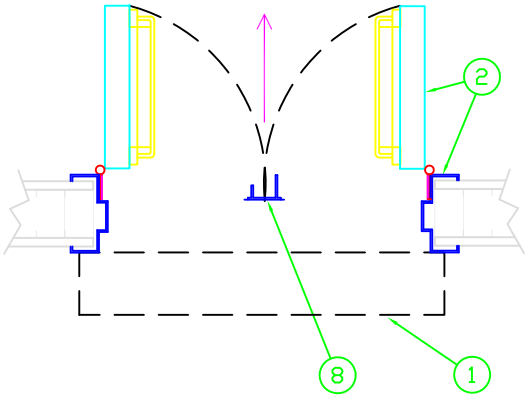

SIMULTANEOUS PAIR FIRE DOORS

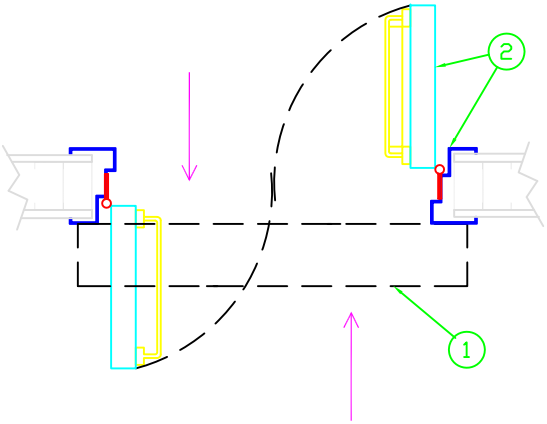

DOUBLE EGRESS FIRE DOORS

NOTES :

A. THE BESAM AUTOMATIC DOOR ACCESSORY PACKAGE: CAN BE USED FOR ANY SINGLE FIRE DOOR WITH RATING LABEL "A", "B", "C", "D", OR "E". IT MAY ALSO BE USED FOR DOUBLE EGRESS FIRE DOORS WITH RATING LABEL "A", OR "B". USEAGE FOR SIMULTANEOUS PAIR FIRE DOORS IS LIMITED TO THOSE WITH RATING LABEL "B", UNLESS AN (UL. APPROVED) OVERLAPPING ASTRAGAL AND CO-ORDINATOR ARE USED TO INSURE PROPER CLOSING AND SEALING.

B. BESAM AUTOMATIC FIRE DOOR ACCESSORY PACKAGE INCLUDES THE FOLLOWING :
BESAM SWING DOOR OPERATOR; (CHOOSE ONE).
(1) 1A. POWER SWING.
1B. SWINGMASTER 900.
1C. SW100.
1D. SW200i.
(4) CAUTION LABELS.

C. ACTUATING DEVICES FOR THE FIRE DOOR.
ANY APPROVED MOTION SENSING DEVICE. OR PUSH PLATE SWITCH (STAINLESS STEEL); WITH ROUND OR SQUARE PLATE; (CHOOSE ONE) AND WITH FACE PLAIN OR ENGRAVED "PUSH TO OPEN" (CHOOSE ONE).

D. SAFETY AND HOLD OPEN DEVICES FOR THE FIRE DOOR.
ANY APPROVED SAFETY AND/OR HOLD-OPEN DEVICE INCLUDING CONTACT SAFETY MATS WITH TRIM AND THRESHOLDS MAY BE USED.

E. DEPENDING UPON THE FIRE RATING LABEL REQUIRED, THE FOLLOWING RECOMMENDED UNDERWRITERS LABORATORIES (UL.) LISTED MANUAL HARDWARE SHOULD BE SPECIFIED.

(2) UL. LISTED FIRE DOORS AND FRAMES

(7) UL. LISTED FIRE RATED VERTICAL ROD DEVICES, ADAMS RITE 3100, 3300, 3600, 3700, AND 3900 SERIES OR SIMILAR, SURFACE OR CONCEALED.
NOTE:
ACCEPTABLE SUBSTITUIONS: SARGENT, NORTON OR CORBIN RUSSWIN

(3) HEAT AND SMOKE DETECTOR(S) (WITH 2 NORMALLY CLOSED CONTACTS) OR A CENTRAL ALARM SYSTEM. FOR "A" LABEL RATING;

(5) AUTOMATIC FLUSH BOLTS

(8) DOOR CO-ORDINATOR FOR SIMULTANEOUS PAIRS.

FOR SINGLE DOORS;

(6) A UL. LISTED FIRE RATED SURFACE RIM PANIC DEVICE.

(9) JAMB MOUNTED COMPATIBLE UL. FIRE RATED ELECTRIC STRIKE.

F. THE ARCHITECTURAL HARDWARE SPECIFIER SHOULD VERIFY THE COMPATABILITY OF ANY OTHER HARDWARE WITH THE BESAM FIRE DOOR ACCESSORY PACKAGE.

STANDARD FINISH OF OPERATOR HOUSING. :
DARK BRONZE - AA-C23-A44.
CLEAR - AA-C23-A31.
SPECIAL FINISHES ARE AVAILABLE.

NOTE:
ALL DOORS AND RELATED FIRE DOOR HARDWARE BY OTHERS.

DWG NO.	1015877								
DRN BY	MHW	DATE	10/20/16	CHK BY	SS	DATE	10/20/16	REV.	1.0	DATE

ASSA ABLOY