


THIS DRAWING IS FOR
PLANNING PURPOSES ONLY
DO NOT USE FOR
CONSTRUCTION

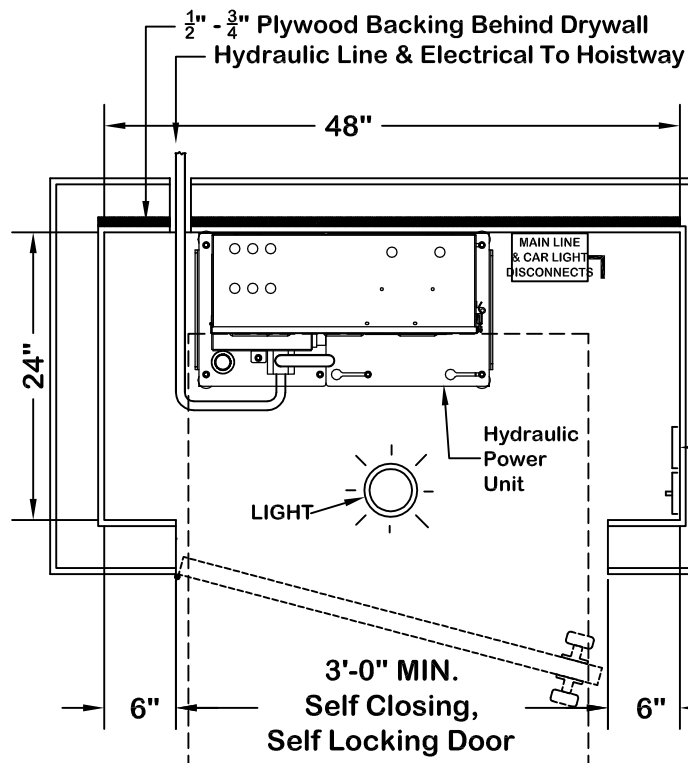

OVERHEAD
VIEW

Light
Switch
&
Duplex
Receptacle

Main Line Disconnect
Single Phase

Square D - H322N Or Equivalent
2 Pole W/ Auxiliary Contact Or 3 Pole

Three Phase
Square D - H321N Or Equivalent
3 Pole W/ Auxiliary Contact

Car Light Disconnect
Square D - G221N Or Equivalent.


MAIN CONTROL BOX
30"H X 22"W X 8 1/4"D

HYDRAULIC POWER UNIT
33 1/2"H X 24 1/4"W X 12 3/4"D

NOTES:

- 1) The Elevator Machine Room Location And Layout Must Meet The Code Requirements Defined By The Local Authority Having Jurisdiction.
- 2) 30" Wide x 36" Deep Clear Working Space In Front Of The Motor Controller And Disconnects As Required By National Electrical Code (NFPA70).
- 3) The Disconnects and Light Switch Must Be Located On The Strike Side Of The Machine Room Door.
- 4) The Hydraulic Power Unit Must Be Located Within 40' Of The Cylinder.
- 5) The Machine Room Must Be Free Of All Equipment Not Related To The Elevator.
- 6) The Minimum Machine Room Headroom is 7' 0".
- 7) The Machine Room Must Be Maintained Between 50° to 80° F, with relative humidity from 5 to 95%, non-condensing.

FRONT
VIEW

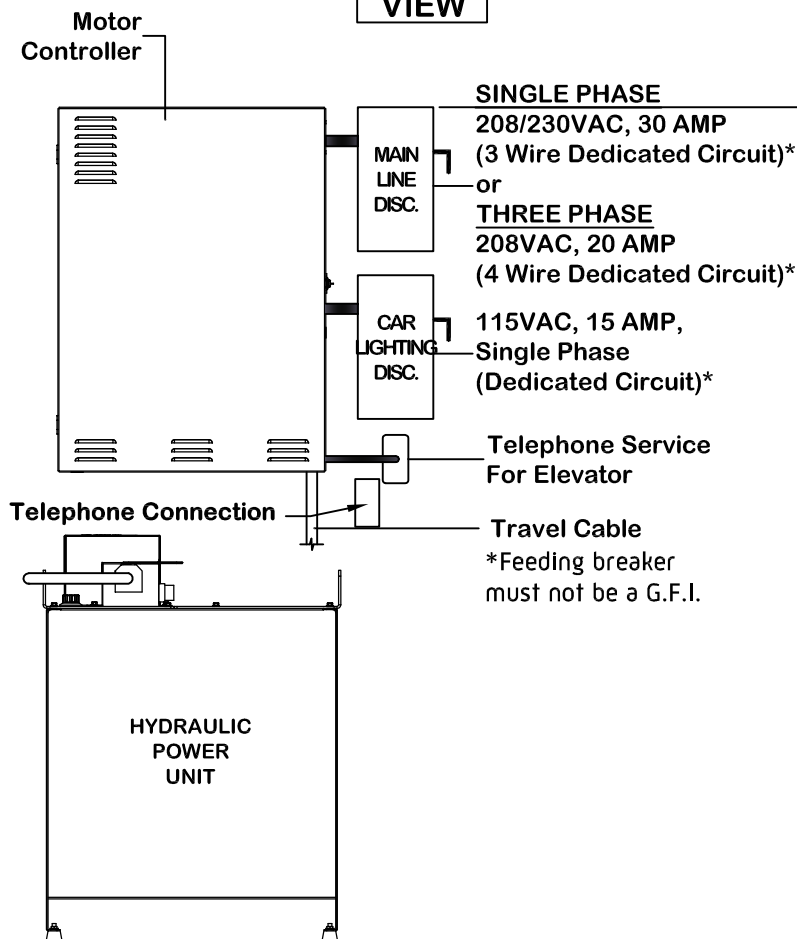

78" MAXIMUM HEIGHT
84" MINIMUM INTERIOR HEIGHT

symmetry

SYMMETRY ELEVATING
SOLUTIONS

| | | | |
|---|--------------------------|-----------------------|---------------|
| TITLE ELEVATION - COMPACT MACHINE ROOM | | | SCALE NONE |
| DRAWN BY TKG | ORIGINAL DATE 2/19/19 | DRAWING NO. LULA19 | REV R0 |
| JOB INFORMATION | | | |