


# VENT PIPE FLASHING


MC-02

(Shows Required Two-Step Deck And Tile Flashing)

STEP 1: DECK FLASHING

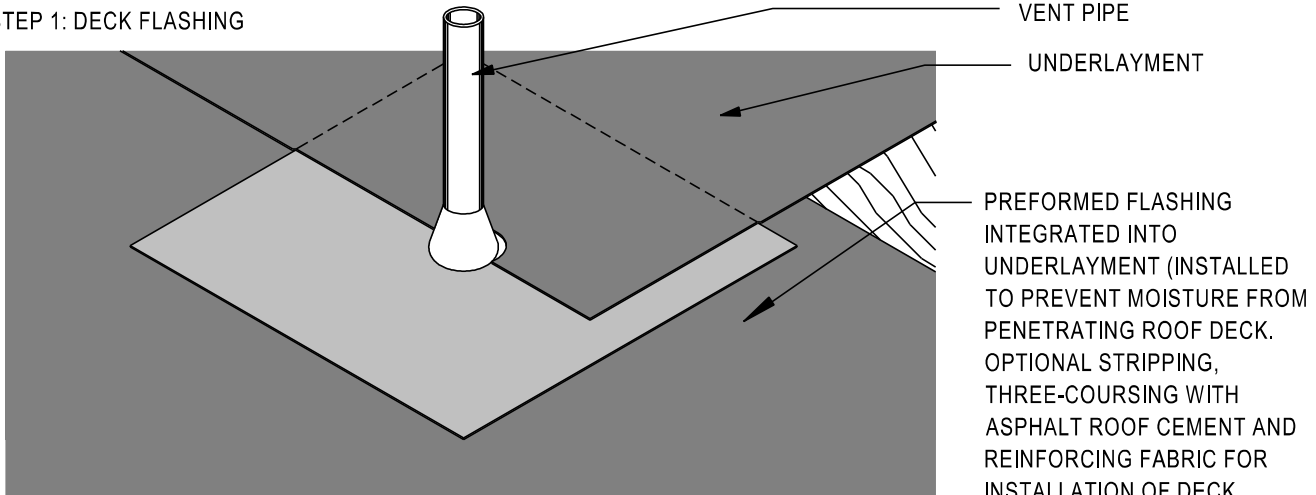

STEP 2: TILE FLASHING

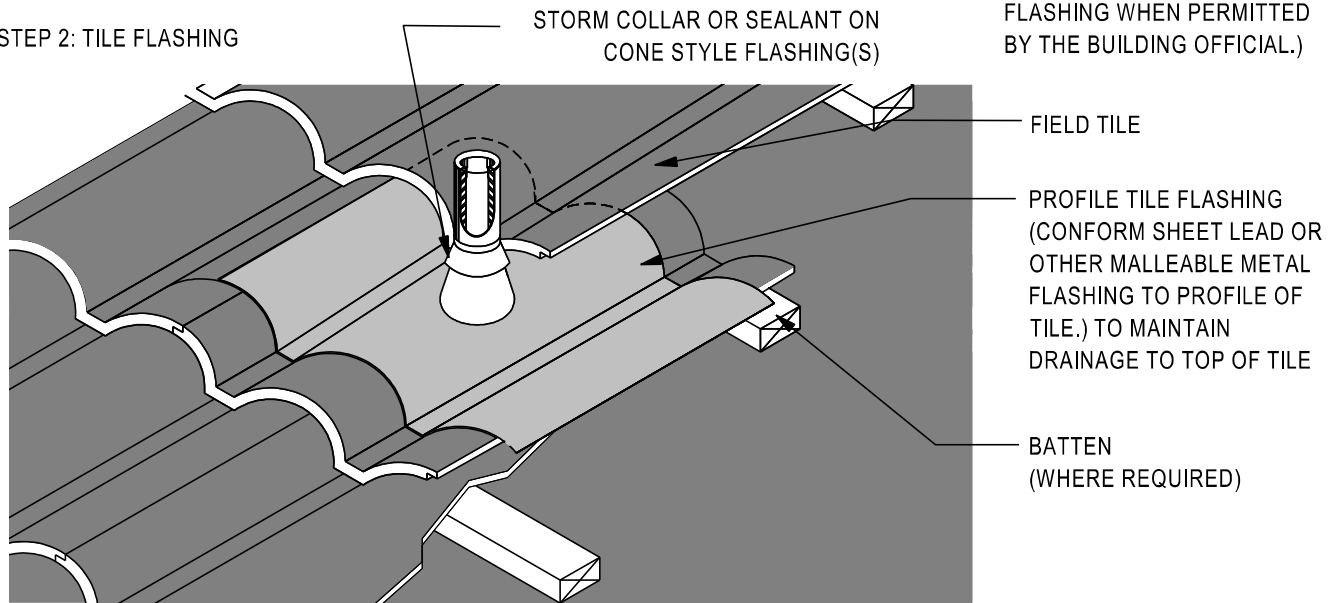

ALL PIPES AND VENTS SHOULD BE LOCATED IN SUCH A MANNER AS TO NOT IMPEDE FLASHINGS AT ROOF TRANSITION.

Notes:

1. For recommended underlayment and fastening requirement, see Table 1A and 1B.
2. All vent pipes require a deck flashing and tile flashing.
3. Tile flashings shall extend onto the tile a minimum of 4" on flat tile and a minimum of 1" past the crown of a profiled tile.
4. Dimensions shown are minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.
5. For flat tile, rigid flashing materials may be used.

