


# TYPICAL SECTION - NOT FOR CONSTRUCTION

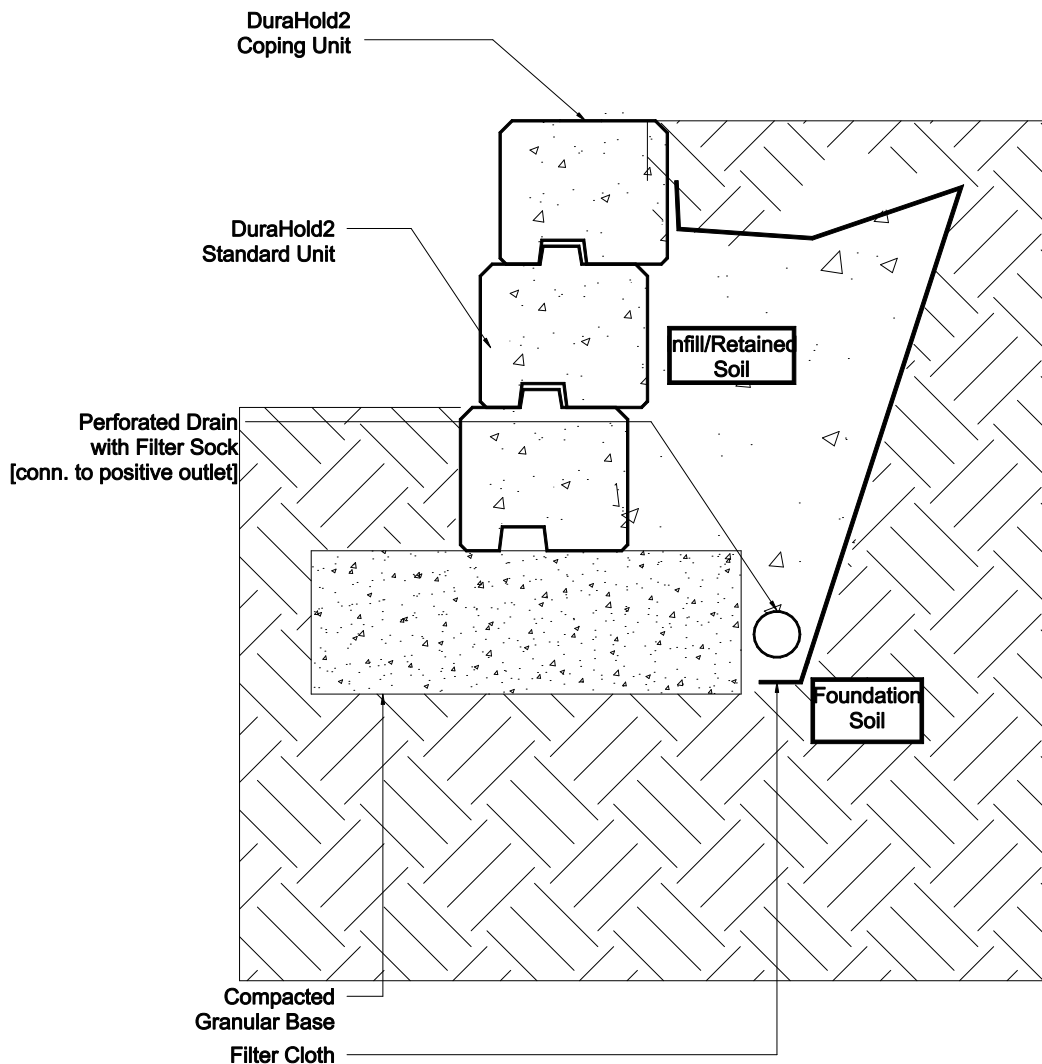

## Design Specific Geometric Information

|  |   |                                   |                     |
|--|---|-----------------------------------|---------------------|
| Retaining Wall System                    | Durahold2                                     | Geogrid Type and Manufacturer     | N/A                 |
| Maximum Height mm (in)                   | 990 (38)                                      | Minimum Geogrid LTDS kN/m (lb/ft) | N/A                 |
| Maximum Slope Above Wall                 | Horizontal                                    | Maximum Slope Below Wall          | None                |
| Max. Surcharge Above Wall kPa (lb/sq.ft) | Pedestrian Surcharge<br>2.4 kPa (50 lb/sq.ft) | Depth of Embedment mm (in)        | 305 (12)            |
| Batter of Wall                           | 7.12 °  | Compacted Base Dimension mm (in)  | 915 x 305 (36 x 12) |

## Design Specific Soil Information

|                                      | Soil Region  |  |   |  |  |
|--------------------------------------|--|--|---|--|--|
|                                      | Infill / Retained                                    | Foundation   | Base  | Drainage   |  |
| Description (by USCS)                | GP<br>Angular 3/4" clear stone (no fines)            | CL<br>Inorganic Clays Low Plasticity                           | GW<br>Well graded, free draining Granular           | see infill   |  |
| Effective Internal Friction Angle    | 36 °   | 28 °   | 39 °  | NR   |  |
| Moist Unit Weight kN/cu.m (lb/cu.ft) | 18 (115)   | 20 (127)   | 22 (140)  | NR   |  |
| Effective Cohesion kPa (lb/sq.ft)    | NR   | 13 (270)   | NR  | NR   |  |
| Soil Notes                           | Placed in 150mm (6") lifts and compacted to 95% SPD. | Angular drain stone placed at 1H:1V from heel of wall as shown | Allowable bearing cap.must exceed 50kPa (1050 psf). | Crushed Gravel (free draining) compacted to 98% SPD. | Gravel infill must be gap graded, angular, free drain w/ no fines. |

NR - Not Required

Notes:

1. This design meets or exceeds the minimum factors of safety required by Risi Stone Systems based on the design parameters listed above. The analysis was performed as outlined in the National Concrete Masonry Association Design Manual for Segmental Retaining Walls, Second Edition. This is a typical, non site-specific Design.
2. No analysis of global stability, total or differential settlement, or seismic effects has been performed.
3. This design is only provided to illustrate the general arrangement of the SRW structure for preliminary costing and feasibility purposes only. This drawing is not for construction. A qualified Engineer must be retained to provide the Final Design prior to construction.
4. Structures such as handrails, guardrails, fences, terraces, and site conditions such as water applications, drainage and soil conditions, additional live and dead loads, etc., have significant effects on the wall design and have not been taken into account in this typical section. When accounted for in the Final Design, other conditions and elements may result in additional design measures (geogrid, drainage, etc) and cost.



**RisiStone**<sup>®</sup>  
retaining wall systems

8500 Leslie Street, Suite 390  
Thornhill, ON Canada L3T 7M8  
Phone:905.882.5898 Fax: 905.882.4556  
www.risistone.com

© 2007 Risi Stone Systems

**DuraHold2**<sup>®</sup>

Retaining Wall  
Gravity Section

990mm (3.25ft)

Site: Surcharge - Clays

Infill: Granular

D21GBQAI099