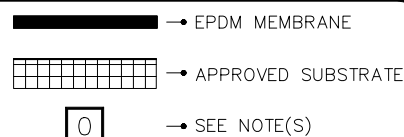


NOTES:

- FOR EXPANSION JOINT INTERSECTIONS AND INTERSECTIONS BETWEEN EXPANSION JOINTS TO WALL OR EDGING, USE TWO LAYERS OF QUICK-APPLIED UNCURED EPDM FLASHING WITH SECOND LAYER 3" (7.5cm) LARGER THAN PREVIOUS LAYER IN ALL DIRECTIONS.
- ROOF MEMBRANE SHALL BE LOOSE-LAID OVER THE EXPANSION JOINT SUPPORT OR SPONGE TUBING.
- WIDTH OF JOINT SHALL BE A MINIMUM OF 3/4" (2cm) AND MAXIMUM 3" (7.5cm) WHEN USING VERSICO EXPANSION JOINTS.
- HPX FASTENERS AND POLYMER SEAM PLATES ARE REQUIRED ON MECHANICALLY FASTENED SYSTEMS OVER STEEL DECKS.

MAXIMUM WARRANTY: 30 YEARS

DECK-TO-DECK
EXPANSION JOINT

THERMOSET
ROOFING SYSTEM
VGC-3.1