



WESTERN ELECTRO - ACOUSTIC LABORATORY

A division of Veneklasen Associates, Inc.

TESTING • CALIBRATION • RESEARCH

25132 Rye Canyon Loop Santa Clarita, California 91355 Tel: (661) 775-3741 Fax: (661) 775-3742 www.weal.com

SOUND TRANSMISSION LOSS TEST REPORT NO. TL12-305

CLIENT: **Amsco**
1880 South 1045 West
P.O. Box 25368
Salt Lake City, UT 84125
TEST DATE: 15 May 2012

Page 1 of 2
12 June 2012

INTRODUCTION

The methods and procedures used for each test conform to the provisions and requirements of ASTM E 90-09, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions* and ASTM E2235-04^{e1}, *Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods*. Copies of the test standard are available at www.astm.org. The test chamber source and receiving room volumes are 204 and 148.4 cubic meters respectively. Western Electro-Acoustic Laboratory is accredited by the United States Department of Commerce, National Institute of Standards and Technology under the National Voluntary Accreditation Program (NVLAP) Lab Code 100256-0 for this test procedure. This test report relates only to the item(s) tested. This report must not be used to claim product certification, approval, or endorsement by WEAL, NVLAP, NIST or any agency of the federal government.


DESCRIPTION OF TEST SPECIMEN

The test specimen was an Amsco V91 Series vinyl horizontal sliding window assembly. The specimen was installed by screwing the nailing fin around the entire perimeter to the wood edge of the test chamber opening. The specimen was sealed into the test chamber opening with latex caulking under the nailing fin and a heavy duct seal putty around the entire perimeter of the receiving room side. The glazing consisted of 22.2 mm (7/8 inch) dual glazed units which were 3 mm (1/8 inch) double strength glass, 15.7mm (5/8 inch) air space, and 3 mm (1/8 inch) double strength glass. The fixed unit was glazed into the main frame and the operable unit was glazed into its individual frame using glazing tape and a vinyl snap in bead. The weather stripping used was 260 high 187 back (.260 in. x .187 in.) fin seal on the full exterior perimeter of the operable panel. 260 high 187 back fin seal was also used on the fixed meeting rail. The net outside frame dimensions of the window assembly were 1.82 m (71-1/2 inches) wide by 1.21 m (47-1/2 inches) high by 66.7 mm (2-5/8 inches) deep. The overall weight of the assembly was 32.7 kg (72 lbs.) for a calculated surface density of 14.9 kg/m² (3.05 lbs./ft²). The operable portion of the assembly was opened and closed five times immediately prior to the test.

RESULTS OF THE MEASUREMENTS

One-third octave band sound transmission loss values are plotted and tabulated on the attached sheet. ASTM minimum volume requirements are met at 80 Hz and above. The Outdoor-Indoor Transmission Class rating determined in accordance with ASTM E 1332-90(2003) was OITC-22. The Sound Transmission Class rating determined in accordance with ASTM E 413-04 was STC-28.

Approved:


Gary E. Mange
Laboratory Director

Respectfully submitted,
Western Electro-Acoustic Laboratory


Raul Martinez
Acoustical Test Technician

Report must be distributed in its entirety except with written authorization from Western Electro-Acoustic Laboratory




NVLAP LAB CODE 100256-0

WESTERN ELECTRO-ACOUSTIC LABORATORY

Report No. TL12-305

Page 2 of 2

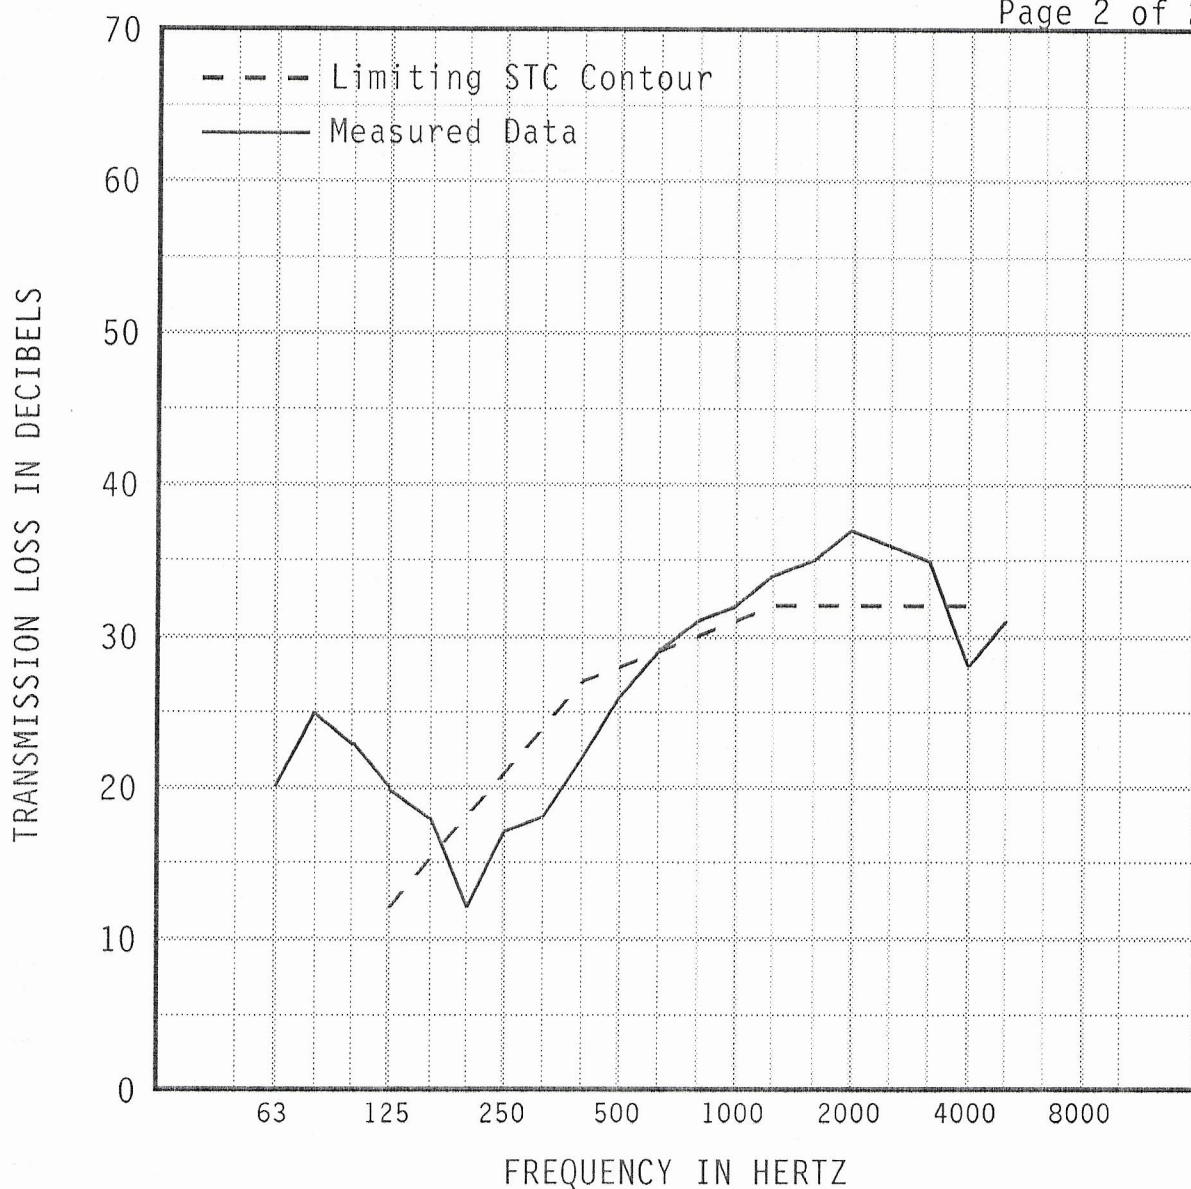

1/3 OCT BND CNTR FREQ	63	80	100	125	160	200	250	315	400	500
TL in dB	20	25	23	20	18	12	17	18	22	26
95% Confidence in dB deficiencies	1.42	1.92	2.07	1.47	0.89	0.76 (6)	0.80 (4)	0.52 (6)	0.36 (5)	0.38 (2)
1/3 OCT BND CNTR FREQ	630	800	1000	1250	1600	2000	2500	3150	4000	5000
TL in dB	29	31	32	34	35	37	36	35	28	31
95% Confidence in dB deficiencies	0.29 (0)	0.44	0.38	0.39	0.36	0.56	0.55	0.31	0.32 (4)	0.50

EWR	OITC
29	22

Specimen Area: 23.59 sq.ft.
 Temperature: 72 deg. F
 Relative Humidity: 36 %
 Test Date: 15 May 2012

STC
 28
 (27)

Report must be distributed in its entirety except with written authorization from Western Electro-Acoustic Laboratory

NVLAP

NVLAP LAB CODE 100256-0