

# ICC-ES Evaluation Report

**ESR-2281**

Reissued December 2024

*This report also contains:*

- **FL Supplement**

Subject to renewal December 2026

*ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.*

Copyright © 2024 ICC Evaluation Service, LLC. All rights reserved.

<b>DIVISION: 05 00 00— METALS</b>  <b>Section: 05 40 00—Cold- Formed Metal Framing</b>  <b>Section: 05 41 00— Structural Metal Stud Framing</b>	<b>REPORT HOLDER:</b>  <b>TELLING INDUSTRIES</b>  	<b>EVALUATION SUBJECT:</b>  <b>METAL FRAMING</b>	
<b>DIVISION: 09 00 00— FINISHES</b>  <b>Section: 09 22 16.13— Non-Structural Metal Stud Framing</b>			

## 1.0 EVALUATION SCOPE

### Compliance with the following codes:

- 2024, 2021, 2018, 2015, 2012, and 2009 [International Building Code® \(IBC\)](#)
- 2024, 2021, 2018, 2015, 2012, and 2009 [International Residential Code® \(IRC\)](#)

### Property evaluated:

- Structural

## 2.0 USES

Members with a minimum G40 coating are used as nonstructural members as defined by the North American Standard for Cold-Formed Steel Nonstructural Framing (AISI S220).

Members with a minimum G60 coating are used as structural members as defined by the North American Standard for Cold-Formed Steel Structural Framing (AISI S240) and the North American Standard for Cold-Formed Steel Framing - General Provisions (AISI S200), as applicable and may also be used as nonstructural members.

## 3.0 DESCRIPTION

### 3.1 General:

The metal framing members described in this report are factory-formed from coils of steel at the facilities noted in [Table 8](#). See [Tables 1, 2, 5](#) and [6](#), and [Figure 1](#), for recognized profiles and section names. The C-sections (studs) are manufactured with and without web punch-outs. When provided, punch-outs have a width no greater than one-half the member web height ( $d/2$ ). Punch-out dimensions will vary with web width. Typical

punch-out size for web widths greater than 3 inches (76 mm) is  $1\frac{1}{2}$  inches (38 mm) by 3 inches (76 mm) or  $1\frac{1}{2}$  inches (38 mm) by 4 inches (102 mm). Typical punch-out size for web widths less than 3 inches (76 mm) is  $\frac{3}{4}$  inch (19 mm) by  $2\frac{1}{2}$  inches (64 mm) or  $\frac{3}{4}$  inch (19 mm) by 4 inches (102 mm). See [Figure 2](#) for an illustration of punch-outs. The punch-outs are located along the centerline of the webs of the studs with a minimum center-to-center spacing of 24 inches (610 mm). The minimum distance between the end of the stud and the near edge of the web punch-outs is 10 inches (254 mm). The values for studs in each of the tables of this report are for studs with punch-outs unless otherwise noted.

C-sections with 1.25-inch (32 mm) flanges may have indentations on the flanges. All other surfaces are flat, smooth surfaces. All surfaces of all other members are flat and smooth.

### 3.2 Materials:

Telling Industries metal framing members are cold-formed from steel coils conforming to ASTM A1003 ST33H or ASTM A1003 ST50H for members with a thickness of 33 mils or more, and ASTM A1003 NS33 for members with a thickness of less than 33 mils. The members have either a minimum G40 or G60 galvanized coating. The base-metal thickness is specified in [Tables 1](#) through [6](#).

## 4.0 DESIGN AND INSTALLATION

### 4.1 Design:

The section properties indicated in [Tables 3](#) through [6](#) have been determined in accordance with the North American Specification for the Design of Cold-formed Steel Structural Members (AISI S100). The allowable moments,  $M_a$ , as indicated in [Tables 3](#) through [6](#), are for use with Allowable Strength Design (ASD) and are for flexural members installed with the compression flange continuously braced. For other conditions of compression flange bracing, the allowable moment must be determined in accordance with AISI S100. The design of members must address web crippling, combined bending and web crippling, and combined bending and shear, as applicable, in accordance with the AISI S100. C-sections (studs) listed in [Table 7](#) and channels (tracks) qualify for use with the prescriptive requirements of the IRC. For use of all other sections under the IRC, the cold-formed steel framing members must be limited to engineered structures, in accordance with IRC Section R301.1.3.

### 4.2 Installation:

The framing members must be installed in accordance with the code, the approved plans and this report. If there is a conflict between the plans submitted for approval and this report, this report governs. The approved plans must be made available at the jobsite at all times.

## 5.0 CONDITIONS OF USE:

The Telling Industries metal framing described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The cold-formed steel members are installed in accordance with the code, the approved plans and this report.
- 5.2 Minimum uncoated base-metal thickness of the cold-formed steel members as delivered to the jobsite are at least 95 percent of the design base-metal thickness noted in [Tables 1, 2, 5 and 6](#).
- 5.3 Complete plans and calculations verifying compliance with this report must be submitted to the code official for each project at the time of permit application. The calculations and drawings must be prepared and sealed by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.4 The cold-formed steel members are manufactured under an approved quality control program by ICC-ES

## 6.0 EVIDENCE SUBMITTED

Data in accordance with the [ICC-ES Acceptance Criteria for Cold-formed Steel Framing Members \(AC46\)](#), dated October 2024.

## 7.0 IDENTIFICATION

- 7.1 The ICC-ES mark of conformity, electronic labeling, or the evaluation report number (ICC-ES ESR-2281) along with the name, registered trademark, or registered logo of the report holder must be included in the product label.

**7.2** In addition, each cold-formed steel member is stamped at a spacing not exceeding 96 inches (2440 mm) on center with the Telling Industries name or initials (TI); the section name as described in [Tables 1](#) through [6](#); the minimum uncoated base-metal thickness in mils or decimal inches; in addition to the following:

- For nonstructural members, each member must have the minimum specified yield strength (if other than 33 ksi), and the designation "NS".
- For structural members, each member must have the minimum specified yield strength; and the designation CP 60 for the G60 galvanized coating.

**7.3** The report holder's contact information is the following:

**TELLING INDUSTRIES**  
**4420 SHERWIN ROAD**  
**WILLOUGHBY, OHIO 44094**  
**(440) 974-3370**  
[www.buildstrong.com](http://www.buildstrong.com)  
[technical@tellingindustries.com](mailto:technical@tellingindustries.com)







TABLE 1—C-SECTIONS (STUDS)<sup>1</sup> (Continued)

SECTION	DEPTH <sup>2</sup> (in)	FLANGE (in)	LIP (in)	INSIDE CORNER RADII (in)	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. <sup>3</sup> (in)	SECTION	DEPTH <sup>2</sup> (in)	FLANGE (in)	LIP (in)	INSIDE CORNER RADII (in)	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. <sup>3</sup> (in)
1400S137-54 <sup>4</sup>	14	1.375	0.375	0.0849	54	0.0566	0.0538	1600S162-68 <sup>4</sup>	16	1.625	0.625	0.1069	68	0.0713	0.0677
1400S137-68	14	1.375	0.375	0.1069	68	0.0713	0.0677	1600S162-97	16	1.625	0.625	0.1525	97	0.1017	0.0966
1400S137-97	14	1.375	0.375	0.1525	97	0.1017	0.0966	1600S162-118	16	1.625	0.625	0.1863	118	0.1242	0.1180
1400S162-54 <sup>4</sup>	14	1.625	0.5	0.0849	54	0.0566	0.0538	1600S200-68 <sup>4</sup>	16	2	0.625	0.1069	68	0.0713	0.0677
1400S162-68	14	1.625	0.5	0.1069	68	0.0713	0.0677	1600S200-97	16	2	0.625	0.1525	97	0.1017	0.0966
1400S162-97	14	1.625	0.5	0.1525	97	0.1017	0.0966	1600S200-118	16	2	0.625	0.1863	118	0.1242	0.1180
1400S162-118	14	1.625	0.5	0.1863	118	0.1242	0.1180	1600S250-68 <sup>4</sup>	16	2.5	0.625	0.1069	68	0.0713	0.0677
1400S200-54 <sup>4</sup>	14	2	0.625	0.0849	54	0.0566	0.0538	1600S250-97	16	2.5	0.625	0.1525	97	0.1017	0.0966
1400S200-68	14	2	0.625	0.1069	68	0.0713	0.0677	1600S250-118	16	2.5	0.625	0.1863	118	0.1242	0.1180
1400S200-97	14	2	0.625	0.1525	97	0.1017	0.0966	1600S300-68 <sup>4</sup>	16	3	1	0.1069	68	0.0713	0.0677
1400S200-118	14	2	0.625	0.1863	118	0.1242	0.1180	1600S300-97	16	3	1	0.1525	97	0.1017	0.0966
1400S250-54 <sup>4</sup>	14	2.5	0.625	0.0849	54	0.0566	0.0538	1600S300-118	16	3	1	0.1863	118	0.1242	0.1180
1400S250-68	14	2.5	0.625	0.1069	68	0.0713	0.0677	1600S350-68 <sup>4</sup>	16	3.5	1	0.1069	68	0.0713	0.0677
1400S250-97	14	2.5	0.625	0.1525	97	0.1017	0.0966	1600S350-97	16	3.5	1	0.1525	97	0.1017	0.0966
1400S250-118	14	2.5	0.625	0.1863	118	0.1242	0.1180	1600S350-118	16	3.5	1	0.1863	118	0.1242	0.1180
1400S300-54 <sup>4</sup>	14	3	1	0.0849	54	0.0566	0.0538								
1400S300-68	14	3	1	0.1069	68	0.0713	0.0677								
1400S300-97	14	3	1	0.1525	97	0.1017	0.0966								
1400S300-118	14	3	1	0.1863	118	0.1242	0.1180								
1400S350-54 <sup>4</sup>	14	3.5	1	0.0849	54	0.0566	0.0538								
1400S350-68	14	3.5	1	0.1069	68	0.0713	0.0677								
1400S350-97	14	3.5	1	0.1525	97	0.1017	0.0966								
1400S350-118	14	3.5	1	0.1863	118	0.1242	0.1180								

For SI: 1 inch = 25.4 mm.

<sup>1</sup> See Table 3 for member properties. See Figure 1 for illustration of member cross section.

<sup>2</sup> Depth measured from outside face to outside face of flanges.

<sup>3</sup> Base metal thickness of members, exclusive of coatings, delivered to the jobsite must be a minimum of 95 percent of the design thickness.

<sup>4</sup> Web height-to-thickness ratio, h/t, exceeds 200. Web must have bearing stiffeners in accordance with AISI S100. No holes or punch-outs are permitted in the web.











































TABLE 4—CHANNEL (TRACK) SECTION PROPERTIES (Continued)

Section	Gross Properties <sup>1</sup>					33 ksi Effective Properties <sup>2</sup>				50 ksi Effective Properties <sup>2</sup>				Torsional Properties					
	Area	Weight	I <sub>xx</sub> (in <sup>4</sup> )	R <sub>x</sub> (in)	I <sub>yy</sub> (in <sup>4</sup> )	R <sub>y</sub> (in)	I <sub>xx</sub> (in <sup>4</sup> )	S <sub>xx</sub> (in <sup>3</sup> )	M <sub>a</sub> (in-k)	V <sub>a</sub> (lb)	I <sub>xx</sub> (in <sup>4</sup> )	S <sub>xx</sub> (in <sup>3</sup> )	M <sub>a</sub> (in-k)	V <sub>a</sub> (lb)	J <sub>x1000</sub> (in <sup>4</sup> )	C <sub>w</sub> (in <sup>6</sup> )	X <sub>o</sub> (in)	R <sub>o</sub> (in)	$\beta$
1000T125-68	0.89	3.03	10.522	3.438	0.073	0.286	10.452	1.781	35.19	3261	10.155	1.575	47.15	3261	1.508	1.515	-0.372	3.470	0.989
1000T125-97	1.269	4.32	15.077	3.447	0.100	0.280	15.077	2.907	57.44	8843	15.077	2.753	82.42	9507	4.375	2.123	-0.363	3.477	0.989
1000T125-118	1.549	5.27	18.471	3.453	0.118	0.276	18.471	3.540	82.05	13189	18.471	3.535	105.85	16235	7.966	2.558	-0.357	3.482	0.990
1000T150-43 <sup>3</sup>	0.586	1.99	7.207	3.507	0.080	0.370	6.195	0.837	16.54	822	---	---	---	---	0.397	1.612	-0.513	3.564	0.979
1000T150-54	0.735	2.50	9.061	3.511	0.100	0.368	8.430	1.249	24.69	1628	7.880	1.079	32.29	1628	0.785	2.013	-0.509	3.567	0.980
1000T150-68	0.926	3.15	11.445	3.516	0.124	0.366	11.342	1.846	36.48	3261	10.774	1.621	48.53	3261	1.569	2.522	-0.505	3.571	0.980
1000T150-97	1.320	4.49	16.413	3.526	0.171	0.360	16.413	3.165	62.54	8843	16.413	2.902	86.90	9507	4.550	3.557	-0.495	3.579	0.981
1000T150-118	1.611	5.48	20.121	3.534	0.204	0.356	20.121	3.857	87.30	13189	20.121	3.852	115.32	16235	8.285	4.307	-0.488	3.585	0.982
1000T200-43 <sup>3</sup>	0.631	2.15	8.361	3.64	0.183	0.539	6.722	0.861	17.01	822	---	---	---	---	0.428	3.540	-0.813	3.769	0.953
1000T200-54	0.792	2.69	10.516	3.645	0.228	0.537	9.231	1.295	25.60	1628	8.560	1.111	33.26	1628	0.845	4.434	-0.809	3.772	0.954
1000T200-68	0.997	3.39	13.292	3.651	0.284	0.534	12.551	1.936	38.26	3261	11.820	1.684	50.42	3261	1.690	5.576	-0.803	3.776	0.955
1000T200-97	1.422	4.84	19.087	3.664	0.397	0.528	19.031	3.427	67.72	8843	18.583	3.081	92.25	9507	4.901	7.924	-0.791	3.786	0.956
1000T200-118	1.735	5.91	23.422	3.674	0.476	0.524	23.422	4.420	87.35	13189	23.422	4.208	125.99	16235	8.924	9.649	-0.783	3.793	0.957
1000T250-43 <sup>3</sup>	0.676	2.30	9.515	3.751	0.344	0.713	7.172	0.876	17.32	822	---	---	---	---	0.458	6.477	-1.147	3.987	0.917
1000T250-54	0.848	2.89	11.972	3.757	0.429	0.711	9.913	1.326	26.20	1628	9.141	1.132	33.89	1628	0.906	8.125	-1.142	3.99	0.918
1000T250-68	1.068	3.64	15.138	3.764	0.536	0.708	13.578	1.997	39.46	3261	12.708	1.726	51.68	3261	1.810	10.240	-1.135	3.995	0.919
1000T250-97	1.523	5.18	21.760	3.780	0.751	0.702	20.871	3.596	71.05	8843	20.254	3.201	95.84	9507	5.252	14.617	-1.122	4.005	0.921
1000T250-118	1.860	6.33	26.723	3.791	0.905	0.698	26.538	4.721	93.29	13189	25.721	4.422	132.38	16235	9.562	17.858	-1.112	4.012	0.923
1000T300-54	0.905	3.08	13.427	3.852	0.714	0.888	11.083	1.452	28.69	1628	10.826	1.191	35.65	1628	0.966	13.289	-1.500	4.228	0.874
1000T300-68	1.140	3.88	16.985	3.860	0.893	0.885	14.416	2.377	46.96	3261	14.106	1.904	57.01	3261	1.931	16.771	-1.493	4.233	0.876
1000T300-97	1.625	5.53	24.434	3.878	1.257	0.879	22.441	3.798	75.04	8843	21.530	3.589	107.45	9507	5.602	24.009	-1.478	4.242	0.879
1000T300-118	1.984	6.75	30.024	3.890	1.519	0.875	28.792	4.950	97.82	13189	27.680	4.668	139.76	16235	10.201	29.395	-1.468	4.249	0.881
1000T400-68	1.282	4.36	20.678	4.016	1.982	1.243	16.172	2.330	46.04	3261	15.757	1.894	56.72	3261	2.173	36.414	-2.262	4.774	0.775
1000T400-97	1.828	6.22	29.781	4.036	2.799	1.237	25.207	4.032	79.68	8843	24.036	3.795	113.63	9507	6.304	52.310	-2.246	4.782	0.779
1000T400-118	2.232	7.60	36.626	4.051	3.392	1.233	32.638	5.292	104.58	13189	31.116	4.960	148.50	16235	11.478	64.212	-2.234	4.787	0.782
1150T125-43 <sup>3</sup>	0.631	2.15	9.503	3.881	0.048	0.277	8.164	0.953	18.84	714	---	---	---	---	0.428	1.330	-0.346	3.906	0.992
1150T125-54 <sup>3</sup>	0.792	2.69	11.940	3.883	0.06	0.275	11.109	1.423	28.11	1414	10.376	1.228	36.78	1414	0.845	1.656	-0.343	3.908	0.992
1150T125-68	0.997	3.39	15.067	3.887	0.074	0.272	14.658	2.100	41.49	2832	14.174	1.844	55.21	2832	1.690	2.066	-0.339	3.912	0.992
1150T125-97	1.422	4.84	21.568	3.895	0.102	0.267	21.568	3.493	69.03	8250	21.405	3.270	97.89	8250	4.901	2.888	-0.331	3.918	0.993
1150T125-118	1.735	5.91	26.404	3.901	0.120	0.263	26.404	4.425	87.43	13189	26.404	4.251	127.26	15072	8.924	3.474	-0.325	3.923	0.993
1150T150-43 <sup>3</sup>	0.654	2.22	3.963	0.082	0.354	8.563	0.973	19.220	714.00	7.262	---	---	---	---	2.209	-0.470	4.006	0.986	0.986
1150T150-54 <sup>3</sup>	0.820	2.79	3.966	0.102	0.353	11.726	1.460	28.840	1414.00	6.87	1.254	37.56	1414.00	7.221	2.757	-0.467	4.009	0.986	0.986
1150T150-68	1.033	3.51	3.971	0.127	0.350	15.864	2.173	42.930	2832.00	6.494	1.895	56.74	2832.00	6.825	3.450	-0.463	4.013	0.987	0.987
1150T150-97	1.472	5.01	3.980	0.175	0.345	23.324	3.788	74.850	8250.00	6.038	3.437	102.92	8250.00	6.287	4.854	-0.454	4.021	0.987	0.987
1150T150-118	1.798	6.12	3.987	0.209	0.341	28.569	4.788	94.610	13189.00	5.967	4.611	138.05	15072.00	6.077	5.866	-0.447	4.026	0.988	0.988
1150T200-43 <sup>3</sup>	0.699	2.38	4.107	0.188	0.519	9.239	0.999	19.750	714.00	7.502	---	---	---	---	4.871	-0.752	4.208	0.968	0.968
1150T200-54 <sup>3</sup>	0.877	2.98	4.111	0.234	0.517	12.758	1.510	29.840	1414.00	7.095	1.290	38.630	1414.00	7.241	6.095	-0.748	4.210	0.968	0.968
1150T200-68	1.104	3.76	4.117	0.292	0.514	17.440	2.271	44.890	2832.00	6.695	1.965	58.820	2832.00	7.048	7.657	-0.743	4.215	0.969	0.969
1150T200-97	1.574	5.36	4.129	0.407	0.508	26.818	4.079	80.610	8250.00	6.173	3.634	108.820	8250.00	6.464	10.855	-0.732	4.224	0.970	0.970
1150T200-118	1.922	6.54	4.138	0.488	0.504	32.901	5.435	107.40	13189.00	5.995	5.010	149.990	15072.00	6.196	13.195	-0.724	4.231	0.971	0.971
1150T250-43 <sup>3</sup>	0.744	2.53	13.307	4.230	0.354	0.690	9.811	1.0170	20.09	714	---	---	---	---	0.504	8.930	-1.068	4.417	0.942
1150T250-54 <sup>3</sup>	0.933	3.18	16.734	4.235	0.442	0.688	13.633	1.544	30.51	1414	12.505	1.314	39.33	1414	0.997	11.194	-1.063	4.420	0.942
1150T250-68	1.175	4.00	21.145	4.242	0.552	0.685	18.774	2.338	46.19	2832	17.476	2.011	60.20	2832	1.992	14.091	-1.057	4.425	0.943
1150T250-97	1.676	5.70	30.350	4.256	0.773	0.679	29.267	4.265	84.27	8250	28.347	3.765	112.73	8250	5.778	20.068	-1.045	4.434	0.944
1150T250-118	2.046	6.96	37.232	4.266	0.932	0.675	36.975	5.784	114.30	13189	36.017	5.244	157.00	15072	10.520	24.476	-1.036	4.441	0.946
1150T300-54 <sup>3</sup>	0.990	3.37	18.651	4.341	0.738	0.863	15.715	1.659	32.78	1414	14.899	1.368	40.97	1414	1.057	18.327	-1.404	4.643	0.909
1150T300-68	1.247	4.24	23.576	4.349	0.923	0.860	20.405	2.683	53.01	2832	19.977	2.173	65.06	2832	2.113	23.104	-1.397	4.648	0.910
1150T300-97	1.778	6.05	33.862	4.365	1.298	0.855	31.233	4.668	92.25	8250	30.048	4.43							

TABLE 4—CHANNEL (TRACK) SECTION PROPERTIES (Continued)

Section	Gross Properties <sup>1</sup>					33 ksi Effective Properties <sup>2</sup>				50 ksi Effective Properties <sup>2</sup>				Torsional Properties					
	Area	Weight	I <sub>xx</sub> (in <sup>4</sup> )	R <sub>x</sub> (in)	I <sub>yy</sub> (in <sup>4</sup> )	R <sub>y</sub> (in)	I <sub>xx</sub> (in <sup>4</sup> )	S <sub>xx</sub> (in <sup>3</sup> )	M <sub>a</sub> (in-k)	V <sub>a</sub> (lb)	I <sub>xx</sub> (in <sup>4</sup> )	S <sub>xx</sub> (in <sup>3</sup> )	M <sub>a</sub> (in-k)	V <sub>a</sub> (lb)	J <sub>x1000</sub> (in <sup>4</sup> )	C <sub>w</sub> (in <sup>6</sup> )	X <sub>o</sub> (in)	R <sub>o</sub> (in)	$\beta$
1350T125-118	1.984	6.75	40.054	4.493	0.123	0.249	40.054	5.577	110.20	12808	39.968	5.212	156.05	12808	10.201	4.928	-0.291	4.510	0.996
1350T150-54 <sup>3</sup>	0.933	3.18	19.467	4.567	0.104	0.334	17.098	4.240	34.38	1203	15.773	1.489	44.57	1203	0.997	3.947	-0.421	4.599	0.992
1350T150-68	1.175	4.00	24.562	4.571	0.129	0.332	23.293	2.608	51.53	2409	21.855	2.261	67.68	2409	1.992	4.933	-0.417	4.602	0.992
1350T150-97	1.676	5.70	35.144	4.579	0.179	0.327	35.067	4.624	91.38	7014	34.160	4.153	124.33	7014	5.778	6.924	-0.408	4.609	0.992
1350T150-118	2.046	6.96	43.016	4.585	0.213	0.323	43.016	6.000	118.55	12808	42.912	5.631	168.58	12808	10.520	8.353	-0.402	4.614	0.992
1350T200-54 <sup>3</sup>	0.990	3.37	22.100	4.725	0.240	0.493	18.481	1.797	35.50	1203	16.933	1.529	45.78	1203	1.057	8.769	-0.680	4.799	0.980
1350T200-68	1.247	4.24	27.896	4.730	0.299	0.490	25.437	2.719	53.72	2409	23.666	2.339	70.02	2409	2.113	11.002	-0.675	4.803	0.980
1350T200-97	1.778	6.05	39.954	4.741	0.418	0.485	39.954	4.955	97.91	7014	38.298	4.374	130.95	7014	6.128	15.561	-0.666	4.812	0.981
1350T200-118	2.170	7.38	48.938	4.749	0.501	0.481	48.938	6.745	133.29	12808	48.938	6.084	182.17	12808	11.159	18.883	-0.658	4.818	0.981
1350T250-54 <sup>3</sup>	1.046	3.56	24.733	4.862	0.455	0.660	19.647	1.834	36.25	1203	17.905	1.556	46.57	1203	1.117	16.152	-0.974	5.002	0.962
1350T250-68	1.318	4.48	31.231	4.868	0.569	0.657	27.222	2.792	55.18	2409	25.180	2.390	71.56	2409	2.233	20.311	-0.969	5.007	0.963
1350T250-97	1.879	6.39	44.764	4.881	0.797	0.651	43.449	5.161	101.99	7014	41.227	4.519	135.30	7014	6.479	28.858	-0.957	5.016	0.964
1350T250-118	2.294	7.81	54.860	4.890	0.961	0.647	54.611	7.112	140.55	12808	53.395	6.346	189.99	12808	11.797	35.137	-0.949	5.023	0.964
1350T300-54 <sup>3</sup>	1.103	3.75	27.366	4.981	0.764	0.832	20.668	1.862	36.79	1203	18.754	1.574	47.14	1203	1.178	26.494	-1.295	5.213	0.938
1350T300-68	1.389	4.73	34.566	4.988	0.955	0.829	28.793	2.846	56.23	2409	26.515	2.427	72.67	2409	2.354	33.361	-1.289	5.218	0.939
1350T300-97	1.981	6.74	49.574	5.003	1.343	0.824	46.466	5.312	104.97	7014	43.800	4.624	138.45	7014	6.829	47.541	-1.276	5.228	0.940
1350T300-118	2.419	8.23	60.782	5.013	1.623	0.819	58.718	7.381	145.84	12808	57.131	6.535	195.67	12808	12.436	58.014	-1.267	5.235	0.941
1350T400-68	1.532	5.21	41.236	5.188	2.141	1.182	33.862	3.099	61.24	2409	33.002	2.552	76.41	2409	2.596	72.561	-1.990	5.681	0.877
1350T400-97	2.184	7.43	59.194	5.206	3.023	1.176	51.002	6.297	124.44	7014	49.671	5.259	157.45	7014	7.531	103.775	-1.976	5.691	0.879
1350T400-118	2.667	9.08	72.626	5.218	3.663	1.172	65.435	8.167	161.38	12808	62.783	7.733	231.52	12808	13.713	126.976	-1.965	5.698	0.881
1400T125-54 <sup>3</sup>	0.933	3.18	19.977	4.627	0.061	0.256	17.725	1.767	34.91	1160	16.407	1.517	45.42	1160	0.997	2.559	-0.299	4.643	0.996
1400T125-68	1.175	4.00	25.196	4.630	0.076	0.254	23.552	2.632	52.01	2322	22.662	2.293	68.64	2322	1.992	3.189	-0.296	4.646	0.996
1400T125-97	1.676	5.70	36.024	4.636	0.104	0.249	35.775	4.480	88.53	6761	34.588	4.134	123.76	6761	5.778	4.445	-0.289	4.652	0.996
1400T125-118	2.046	6.96	44.068	4.641	0.123	0.245	44.068	5.853	115.67	12344	43.752	5.453	163.27	12344	10.520	5.334	-0.284	4.656	0.996
1400T150-54 <sup>3</sup>	0.962	3.27	21.392	4.717	0.105	0.330	18.620	1.810	35.76	1160	17.153	1.547	46.33	1160	1.027	4.280	-0.410	4.746	0.993
1400T150-68	1.211	4.12	26.987	4.721	0.130	0.327	25.409	2.717	53.68	2322	23.803	2.352	70.42	2322	2.052	5.349	-0.407	4.749	0.993
1400T150-97	1.727	5.88	38.607	4.729	0.180	0.322	38.340	4.834	95.52	6761	37.285	4.332	129.69	6761	5.953	7.503	-0.399	4.756	0.993
1400T150-118	2.108	7.17	47.247	4.734	0.214	0.319	47.247	6.291	124.31	12344	46.911	5.886	176.24	12344	10.839	9.048	-0.393	4.761	0.993
1400T200-54 <sup>3</sup>	1.018	3.46	24.221	4.878	0.242	0.487	20.098	1.868	36.92	1160	18.387	1.589	47.56	1160	1.087	9.520	-0.665	4.947	0.982
1400T200-68	1.282	4.36	30.571	4.883	0.301	0.485	27.707	2.830	55.93	2322	25.738	2.432	72.81	2322	2.173	11.942	-0.661	4.951	0.982
1400T200-97	1.828	6.22	43.773	4.893	0.420	0.479	43.679	5.174	102.24	6761	41.749	4.559	136.48	6761	6.304	16.883	-0.651	4.959	0.983
1400T200-118	2.232	7.60	53.606	4.900	0.504	0.475	53.606	7.062	139.54	12344	53.453	6.354	190.23	12344	11.478	20.479	-0.644	4.965	0.983
1400T250-54 <sup>3</sup>	1.075	3.66	27.051	5.017	0.458	0.653	21.342	1.907	37.68	1160	19.421	1.616	48.38	1160	1.148	17.550	-0.954	5.149	0.966
1400T250-68	1.354	4.61	34.154	5.023	0.573	0.650	29.615	2.906	57.42	2322	27.352	2.485	74.40	2322	2.294	22.063	-0.949	5.153	0.966
1400T250-97	1.930	6.57	48.939	5.036	0.803	0.645	47.449	5.386	106.42	6761	44.883	4.708	140.94	6761	6.654	31.333	-0.938	5.163	0.967
1400T250-118	2.356	8.02	59.964	5.044	0.967	0.641	59.734	7.438	146.99	12344	58.277	6.622	198.25	12344	12.117	38.137	-0.930	5.169	0.968
1400T300-54 <sup>3</sup>	1.131	3.85	29.881	5.139	0.769	0.825	22.429	1.935	38.24	1160	20.324	1.635	48.96	1160	1.208	28.800	-1.271	5.358	0.944
1400T300-68	1.425	4.85	37.737	5.146	0.962	0.822	31.291	2.961	58.50	2322	28.775	2.523	75.54	2322	2.415	36.257	-1.265	5.363	0.944
1400T300-97	2.032	6.91	54.105	5.160	1.353	0.816	50.615	5.540	109.48	6761	47.633	4.815	144.17	6761	7.005	51.644	-1.252	5.373	0.946
1400T300-118	2.481	8.44	66.323	5.171	1.635	0.812	64.159	7.713	152.42	12344	62.201	6.816	204.06	12344	12.755	62.998	-1.243	5.38	0.947
1400T400-68	1.567	5.33	44.903	5.352	2.160	1.174	37.078	3.210	63.43	2322	35.376	2.647	79.24	2322	2.656	78.896	-1.957	5.818	0.887
1400T400-97	2.235	7.61	64.437	5.369	3.049	1.168	55.644	6.656	131.52	6761	54.354	5.437	162.79	6761	7.706	112.783	-1.943	5.828	0.889
1400T400-118	2.729	9.29	79.041	5.382	3.695	1.164	71.315	8.620	170.34	12344	68.478	8.172	244.66	12344	14.032	137.951	-1.932	5.835	0.890
1600T125-54 <sup>4</sup>	1.046	3.56	28.485	5.217	0.062	0.243	-	-	-	-	-	-	-	-	1.117	3.432	-0.272	5.230	0.997
1600T125-68 <sup>1</sup>	1.318	4.48	35.916	5.220	0.077	0.241	32.443	3.058	60.42	2030	31.004	2.651	79.37	2030	2.233	4.273	-0.268	5.233	0.997
1600T125-97	1.879	6.39	51.322	5.226	0.105	0.237	49.844	5.273	104.19	5908	47.830	4.825	144.47	5908	6.479	5.945	-0.262	5.238	0.997
1600T125-118	2.294	7.81	62.755	5.230	0.125	0.233	62.755	6.965	137.62	10783	60.930	6.420	192.21	10783	11.797	7.126	-0.257	5.241	0.998
160																			

TABLE 5—U CHANNELS STRUCTURAL PROPERTIES<sup>1,2</sup>

SECTION	DEPTH <sup>5</sup>	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. (in)	INSIDE CORNER RADII (in)	WEIGHT (lb/ft)	GROSS SECTION PROPERTIES <sup>3</sup>				EFFECTIVE SECTION PROPERTIES			ALLOWABLE MOMENT <sup>4</sup> M <sub>a</sub> (in-k)	
							Area (in <sup>2</sup> )	I <sub>x</sub> (in <sup>4</sup> )	r <sub>x</sub> (in)	I <sub>y</sub> (in <sup>4</sup> )	r <sub>y</sub> (in)	I <sub>x</sub> (in <sup>4</sup> )	S <sub>x</sub> (in <sup>3</sup> )	Area (in <sup>2</sup> )	
CRC-075-54	0.75	54	0.0566	0.0538	0.0849	0.30	0.087	0.007	0.288	0.002	0.155	0.007	0.019	0.087	0.45
CRC-150-54	1.5	54	0.0566	0.0538	0.0849	0.44	0.129	0.039	0.547	0.003	0.144	0.039	0.052	0.129	1.22
CRC-200-54	2.0	54	0.0566	0.0538	0.0849	0.54	0.157	0.079	0.709	0.003	0.136	0.079	0.079	0.157	1.87
CRC250-54	2.5	54	0.0566	0.0538	0.0849	0.63	0.186	0.139	0.866	0.003	0.128	0.139	0.111	0.186	2.64

For SI: 1 inch = 25.4 mm, 1 lb/ft = 1.488 kg/m, 1 in-lb = 11.30 N-m.

I<sub>x</sub> = Strong axis moment of inertia. r<sub>y</sub> = Weak axis radius of gyration.  
 r<sub>x</sub> = Strong axis radius of gyration. S<sub>x</sub> = Strong axis section modulus.  
 I<sub>y</sub> = Weak axis moment of inertia.

<sup>1</sup>F<sub>y</sub> = 33 ksi.

<sup>2</sup>Use the effective moment of inertia for deflection calculations.

<sup>3</sup>Gross properties are based on the full-unreduced cross section of the U channel.

<sup>4</sup>Full lateral support of compression flanges must be provided.

<sup>5</sup>Depth of member is measured from outside face to outside face of flanges. See [Figure 1](#).

TABLE 6—HAT FURRING CHANNEL PROPERTIES<sup>1,3</sup>

SECTION	MILS	DESIGN THICK. (in)	MIN. BASE METAL THICK. (in)	INSIDE CORNER RADII (in)	WEIGHT (lb/ft)	DEPTH (in)	GROSS SECTION PROPERTIES				EFFECTIVE SECTION PROPERTIES		ALLOWABLE MOMENT <sup>2</sup> M <sub>a</sub> (ft-lb)	
							Area (in <sup>2</sup> )	I <sub>x</sub> (in <sup>4</sup> )	r <sub>x</sub> (in)	I <sub>y</sub> (in <sup>4</sup> )	r <sub>y</sub> (in)	I <sub>x</sub> (in <sup>4</sup> )	S <sub>x</sub> (in <sup>3</sup> )	
DWFC088-18	18	0.0188	0.0179	0.0843	0.239	0.875	0.0702	0.0089	0.356	0.0354	0.710	0.0086	0.0160	26.41
DWFC088-30	30	0.0312	0.0296	0.0784	0.391	0.875	0.1149	0.0143	0.353	0.0580	0.710	0.0143	0.0365	50.47
DWFC150-18	18	0.0188	0.0179	0.0843	0.320	1.500	0.0939	0.0311	0.575	0.0467	0.705	0.0299	0.0344	56.59
DWFC150-30	30	0.0312	0.0296	0.0784	0.525	1.500	0.1543	0.0503	0.571	0.0797	0.705	0.0503	0.0639	105.25

For SI: 1 inch = 25.4 mm, 1 lb/ft = 1.488 kg/m, 1 in-lb = 11.30 N-m.

I<sub>x</sub> = Strong axis moment of inertia.

r<sub>x</sub> = Strong axis radius of gyration.

I<sub>y</sub> = Weak axis moment of inertia.

r<sub>y</sub> = Weak axis radius of gyration.

S<sub>x</sub> = Strong axis section modulus.

<sup>1</sup>F<sub>y</sub> = 33 ksi.

<sup>2</sup>Allowable moment is applicable for both positive and negative moments. Full lateral support of compression flanges must be provided.

<sup>3</sup>Use the effective moment of inertia for deflection calculations.

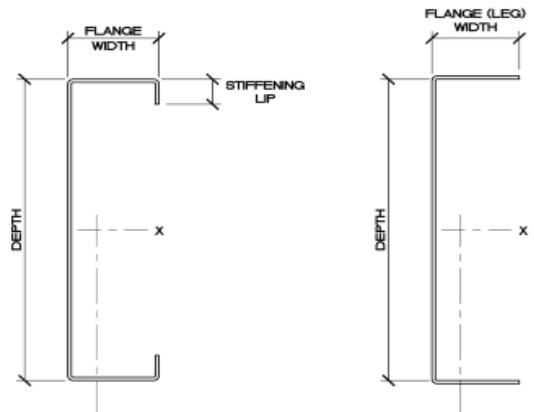
TABLE 7—C-SECTIONS (STUDS) FOR USE WITH THE IRC<sup>1</sup>

IRC MEMBER DESIGNATION		EQUIVALENT TELLING INDUSTRIES MEMBER DESIGNATION							
		t = 33		t = 43		t = 54		t = 68	
350S162-t		350S162-33		350S162-43		350S162-54		350S162-68	
		350S200-33		350S200-43		350S200-54		350S200-68	
550S162-t		550S162-33		550S162-43		550S162-54		550S162-68	
		550S200-33		550S200-43		550S200-54		550S200-68	
800S162-t		800S162-33		800S162-43		800S162-54		800S162-68	
		800S200-33		800S200-43		800S200-54		800S200-68	
1000S162-t		---		1000S162-43		1000S162-54		1000S162-68	
		---		1000S200-43		1000S200-54		1000S200-68	
1200S162-t		---		---		1200S162-54		1200S162-68	
		---		---		1200S200-54		1200S200-68	

1. Under the 2024, 2021, 2018 and 2015 IRC: Minimum Grade 33 ksi steel must be used wherever 33 mil and 43 mil thicknesses are specified; and Minimum Grade 50 ksi steel must be used wherever 54 mil and 68 mil thicknesses are specified.

TABLE 8—MANUFACTURING LOCATIONS

Telling Industries Osceola, Arkansas 72370 870-563-2597	Telling Industries Windsor, Connecticut 06095 860-731-7975	Telling Industries Cambridge, Ohio 43725 740-435-8900
---	--	---

**SECTION PROFILES**

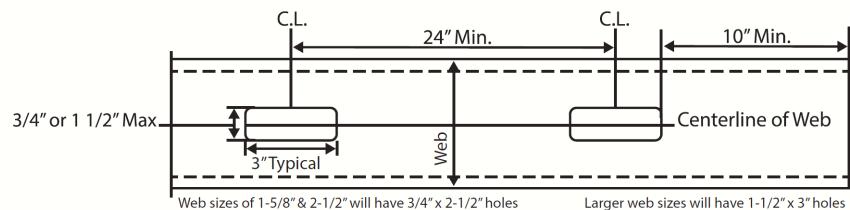
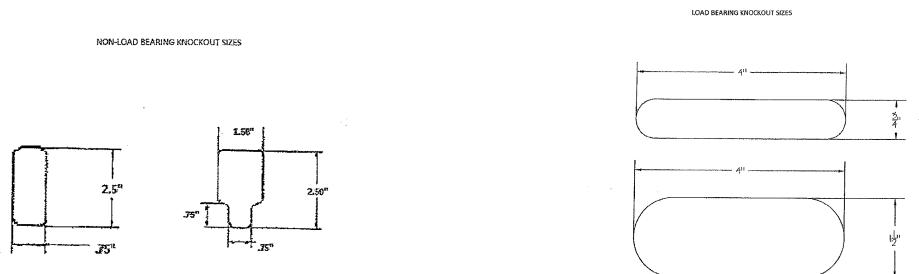
STUD (S) SECTIONS

TRACK (T) SECTIONS



U-CHANNEL (U) SECTIONS

HAT FURRING (F) SECTIONS

**FIGURE 1—SECTION PROFILES****FIGURE 2—PUNCH-OUTS**

Reissued December 2024  
This report is subject to renewal December 2026.

[www.icc-es.org](http://www.icc-es.org) | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 05 00 00—METALS**

Section: 05 40 00—Cold-Formed Metal Framing  
Section: 05 41 00—Structural Metal Stud Framing

**DIVISION: 09 00 00—FINISHES**

Section: 09 22 16.13—Non-Structural Metal Stud Framing

**REPORT HOLDER:**

TELLING INDUSTRIES

**EVALUATION SUBJECT:**

METAL FRAMING

**1.0 REPORT PURPOSE AND SCOPE**

**Purpose:**

The purpose of this evaluation report supplement is to indicate that the metal framing members, described in ICC-ES evaluation report ESR-2281, have also been evaluated for compliance with the codes noted below.

**Applicable code editions:**

- 2023 Florida Building Code—Building
- 2023 Florida Building Code—Residential

**2.0 CONCLUSIONS**

The metal framing members, described in Sections 2.0 through 7.0 of the ICC-ES evaluation report ESR-2281, comply with the *Florida Building Code—Building* and the *Florida Building Code—Residential*. The design requirements must be determined in accordance with the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable. The installation requirements noted in ICC-ES evaluation report ESR-2281 for the 2021 *International Building Code*® meet the requirements of the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable.

Use of the metal framing members has also been found to be in compliance with the High-Velocity Hurricane Zone provisions of the *Florida Building Code—Building* and the *Florida Building Code—Residential* with the following exception:

- Protection of metal must be in accordance with the *Florida Building Code—Building* Section 2222.6.

For products falling under Florida Rule 61G20-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official, when the report holder does not possess an approval by the Commission).

This supplement expires concurrently with the evaluation report, reissued December 2024.